




PANEL	MOUNTING	MAINS AMPS.	MAINS VOLTS	MAIN BREAKER	BRANCH BREAKERS				TOTAL NO. OF CIRCUITS INCLUDING SPACES	REMARKS
					NO. OF SINGLE POLES	OTHERS				
					15A	20A	20A CIRCUITS	BREAKER	CIRCUITS	FEEDER
LP-SLA	SURFACE	100A	240/416		8					18
LP-BLB		100A			6					18
LP-BLC		100A			6					18
LP-ILA		100A			20					30
LP-3LA		200A			30					42
LP-4LA					30					42
LP-5LA					27	7	2, 10, 22, 24, 26, 28, 30			42
LP-6LA					30					42
LP-7LA					30					42
LP-8LA					30					42
LP-9LA					30					42
LP-10A					30					42
LP-11A					30					42
LP-12LA					30					42
LP-13LA					30					42
LP-14LA					30					42
LP-PLA		100A			8					18
RP-BRA	SURFACE	100A	120/208		37	1	24			42
RP-1RA					18					42
RP-1RB					18			1-20A, 3P	19, 21, 23	42
RP-2RA					18					18
RP-2RC					16					18
RP-2RD					14					18
RP-3RA					6					42
RP-4RA					6					42
RP-5RA					12			1-40A, 2P	12, 14	42
RP-6RA					6					42
RP-7RA					12					42
RP-8RA					6					42
RP-9RA					6					42
RP-10RA					6					42
RP-11RA					6					42
RP-12RA					6					42
RP-13RA					6					42
RP-14RA					6					42
RP-PRA					15	1	2	1-20A, 2P	8, 10	24
RP-SEB	PLUSH				11	1	1			24
EP-BEA	SURFACE	100A	240/416		8					18
EP-7EA					6					18
EP-14EA					6					18
EP-BEB		120/208			21			1-15A, 3P	15, 17	30
EP-7EB					14					18
EP-14EB					14			6, 8, 10, 12, 14, 16		24
EP-PED					6			1 TO 6		12
HP-BHA	SURFACE	225A	240/416		2			3-15A, 3P 4-30A, 1P 6-40A, 1P 3-50A, 1P	1-3, 5, 7, 8, 11 12, 13, 14, 15, 16, 17 18, 19, 20, 21 22, 23, 24	24

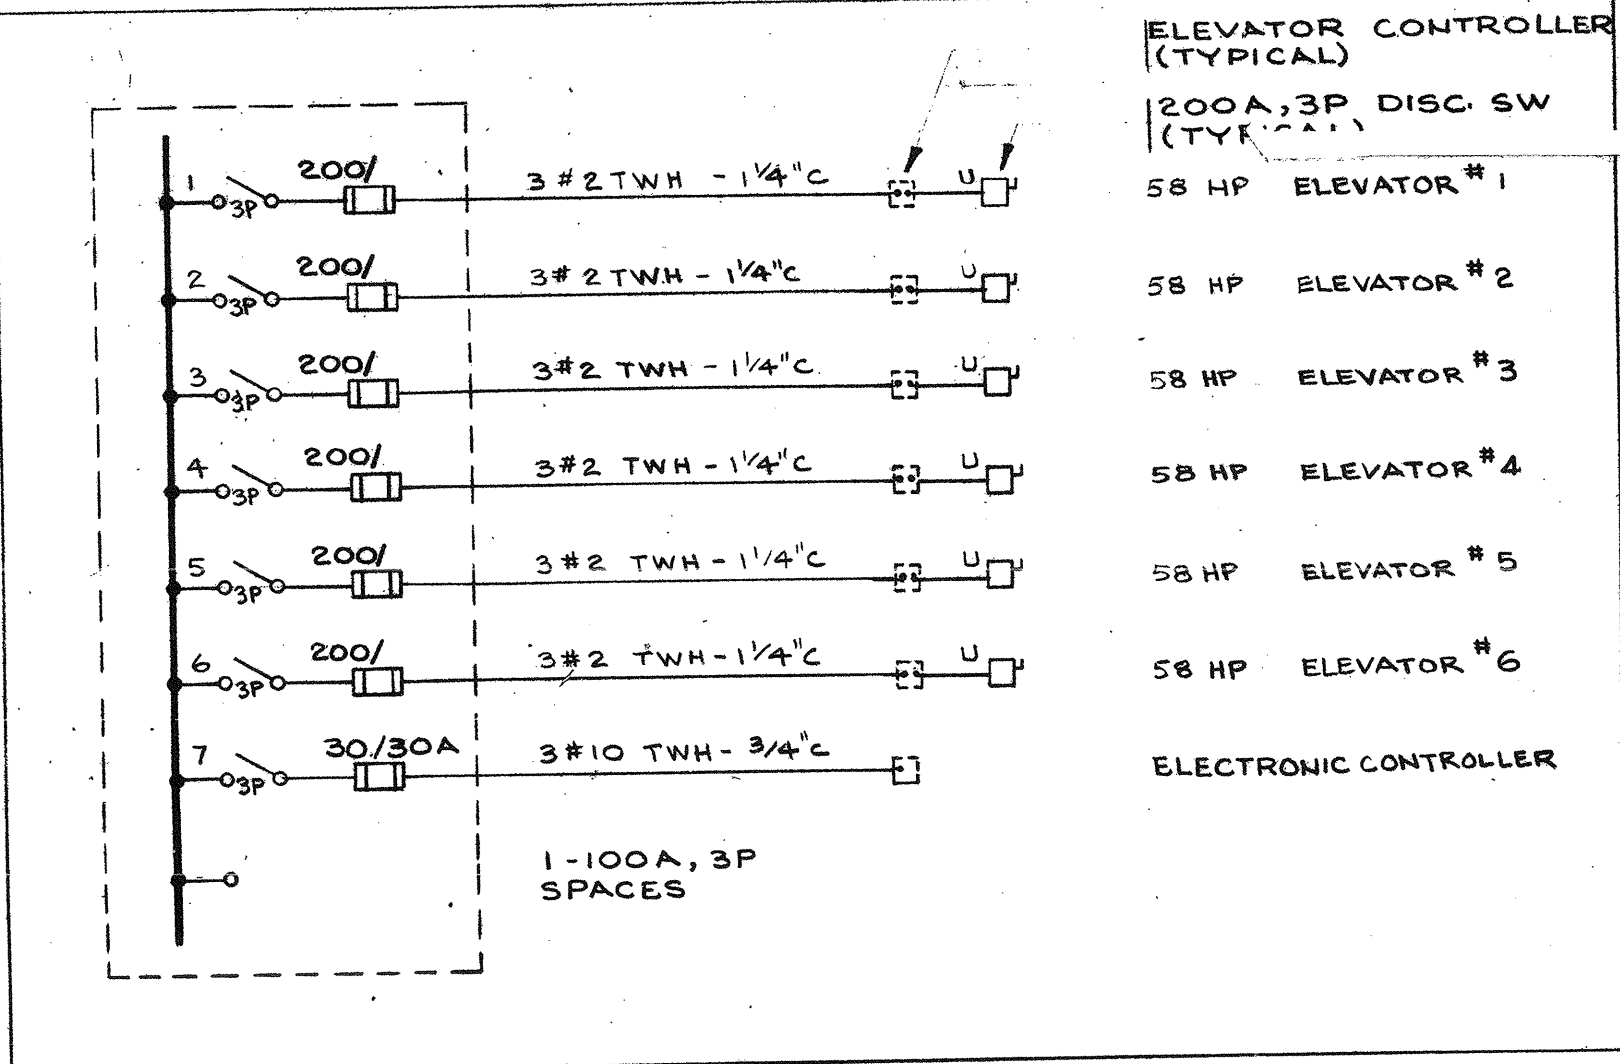


② EDP-PDA (416V, 3Ø, 3W, 800A. MAINS)

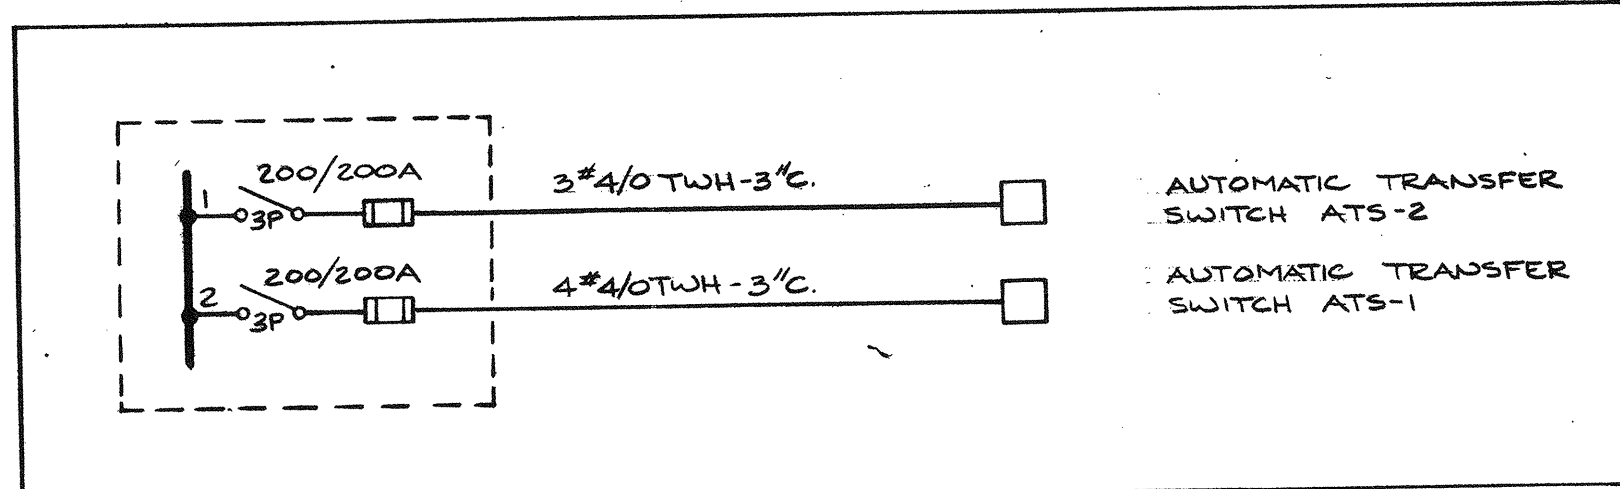


③ EDP-PDB (240/416V, 3Ø, 4W, 400A. MAINS)

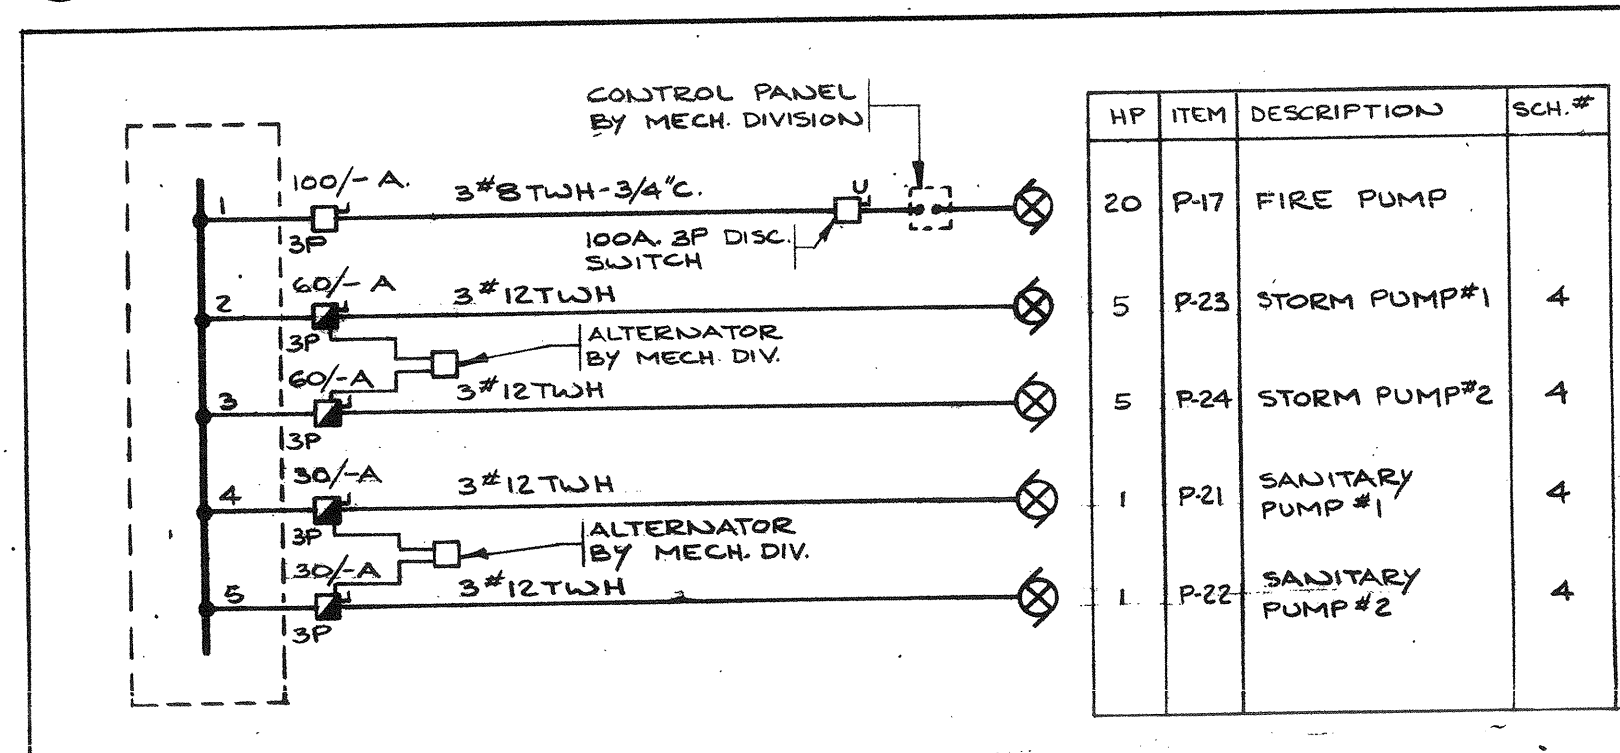


④ SPLITTER SP-A (416V, 3Ø, 3W, 200A. MAINS)

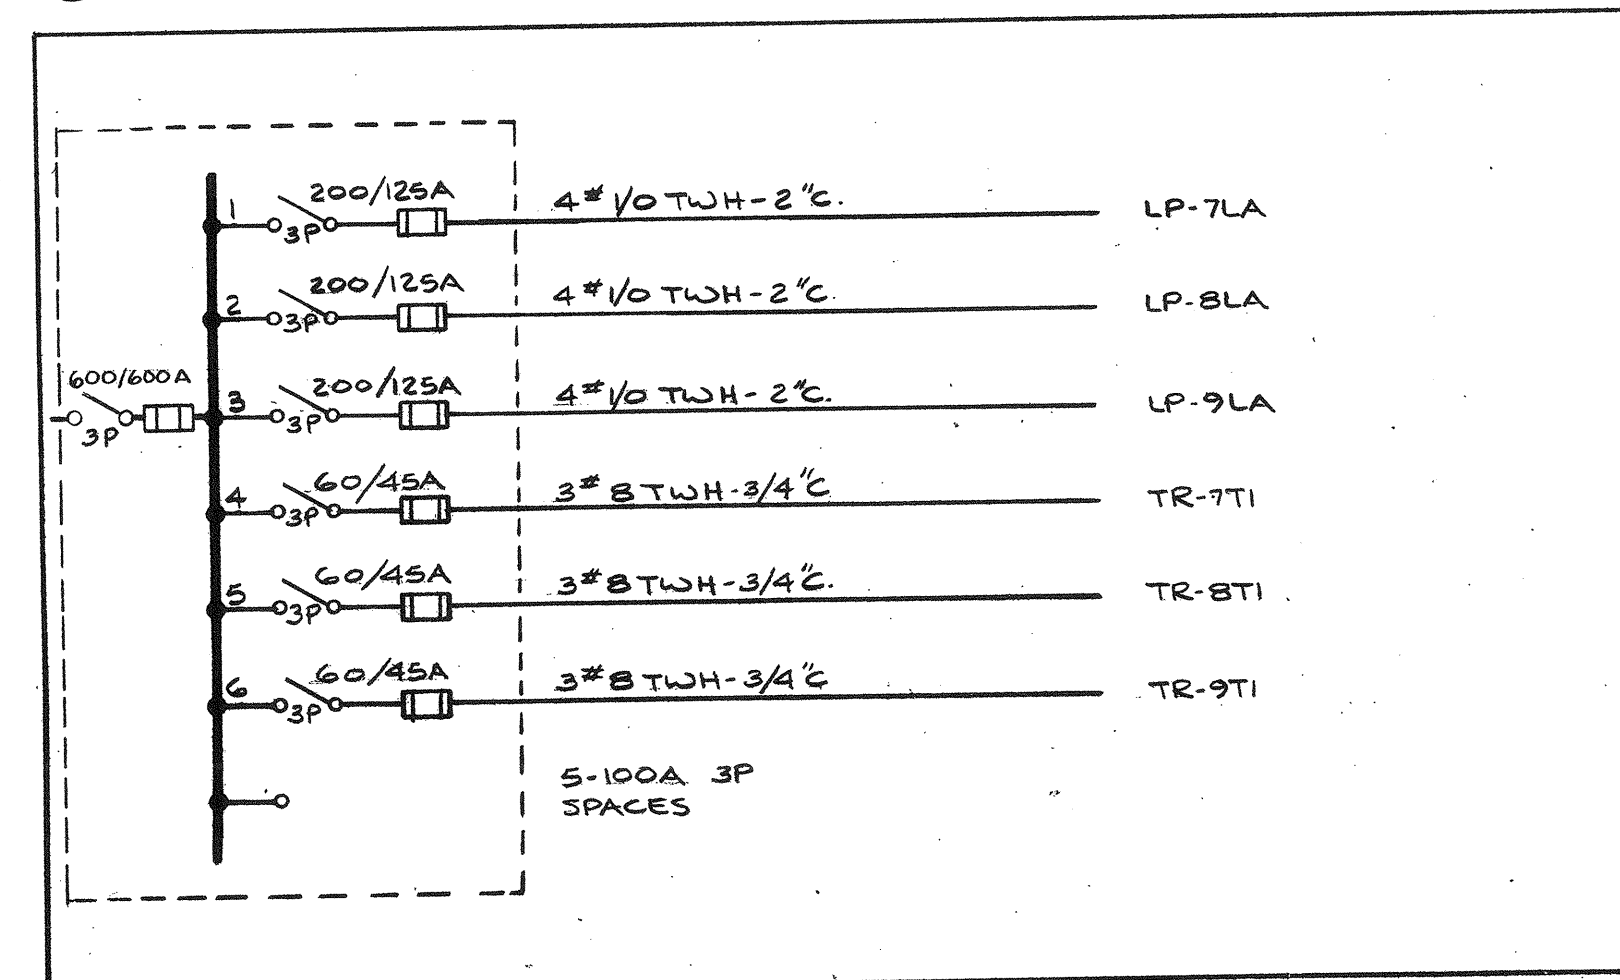


⑤ DP-8DA (240/416V, 3Ø, 4W, 600A. MAINS)
(TYPICAL FOR DP-11DA AND DP-14DA)

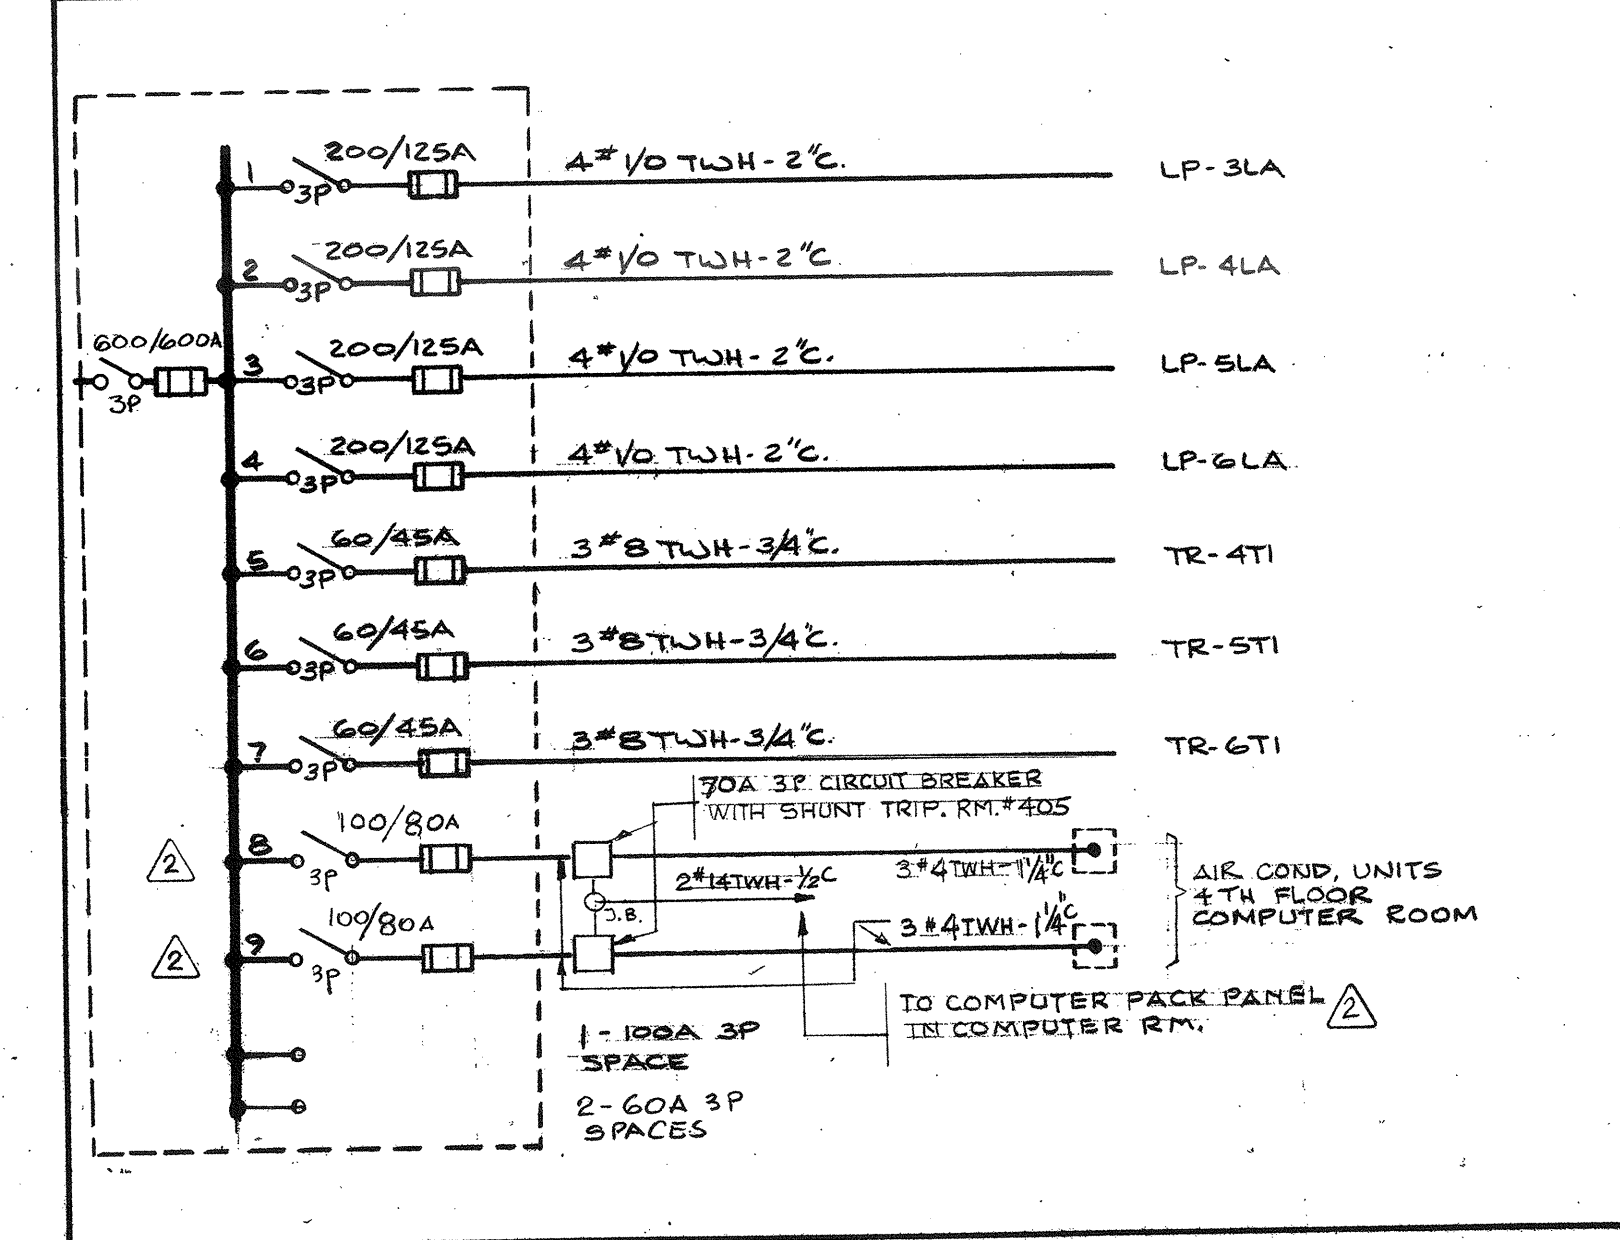


⑥ DP-5DA (240/416V, 3Ø, 4W, 600A. MAINS)

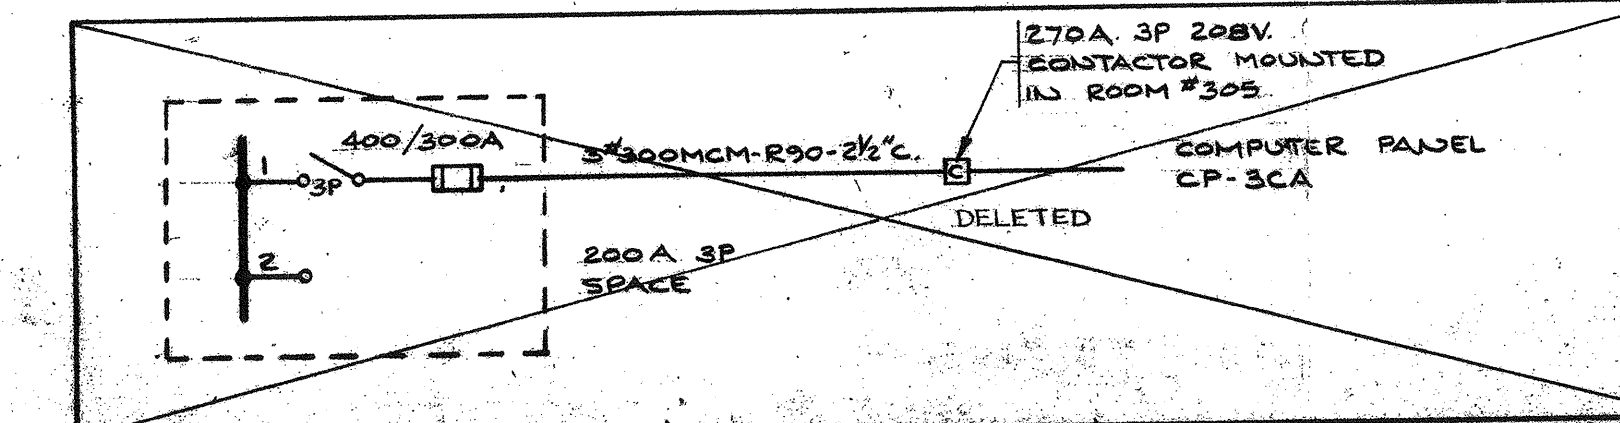


⑦ DP-3DA (120/208V, 3Ø, 4W, 600A. MAINS)

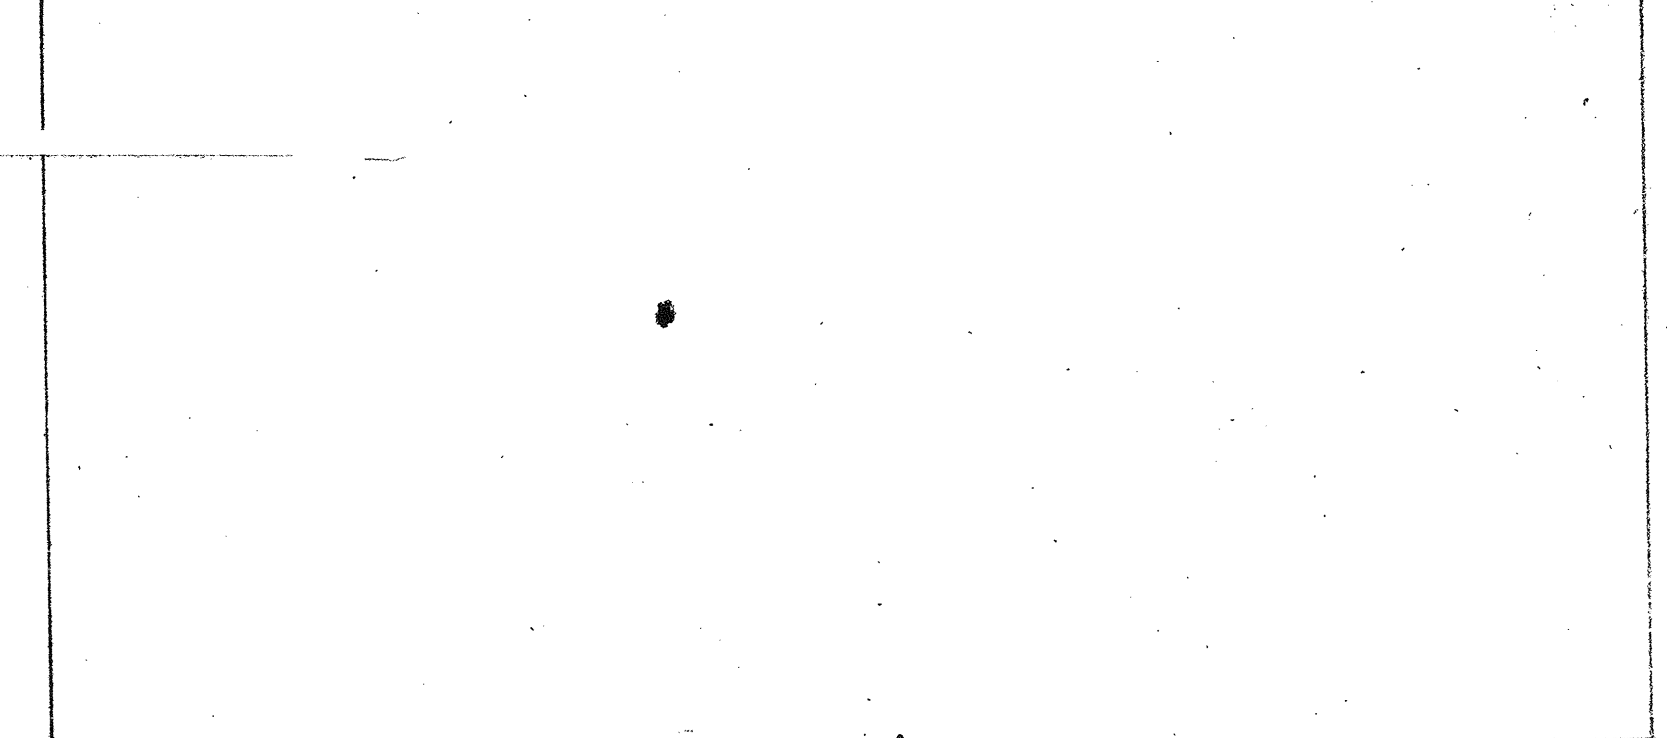


⑧ DP-2DA (120/208V, 3Ø, 4W, 800A. MAINS)

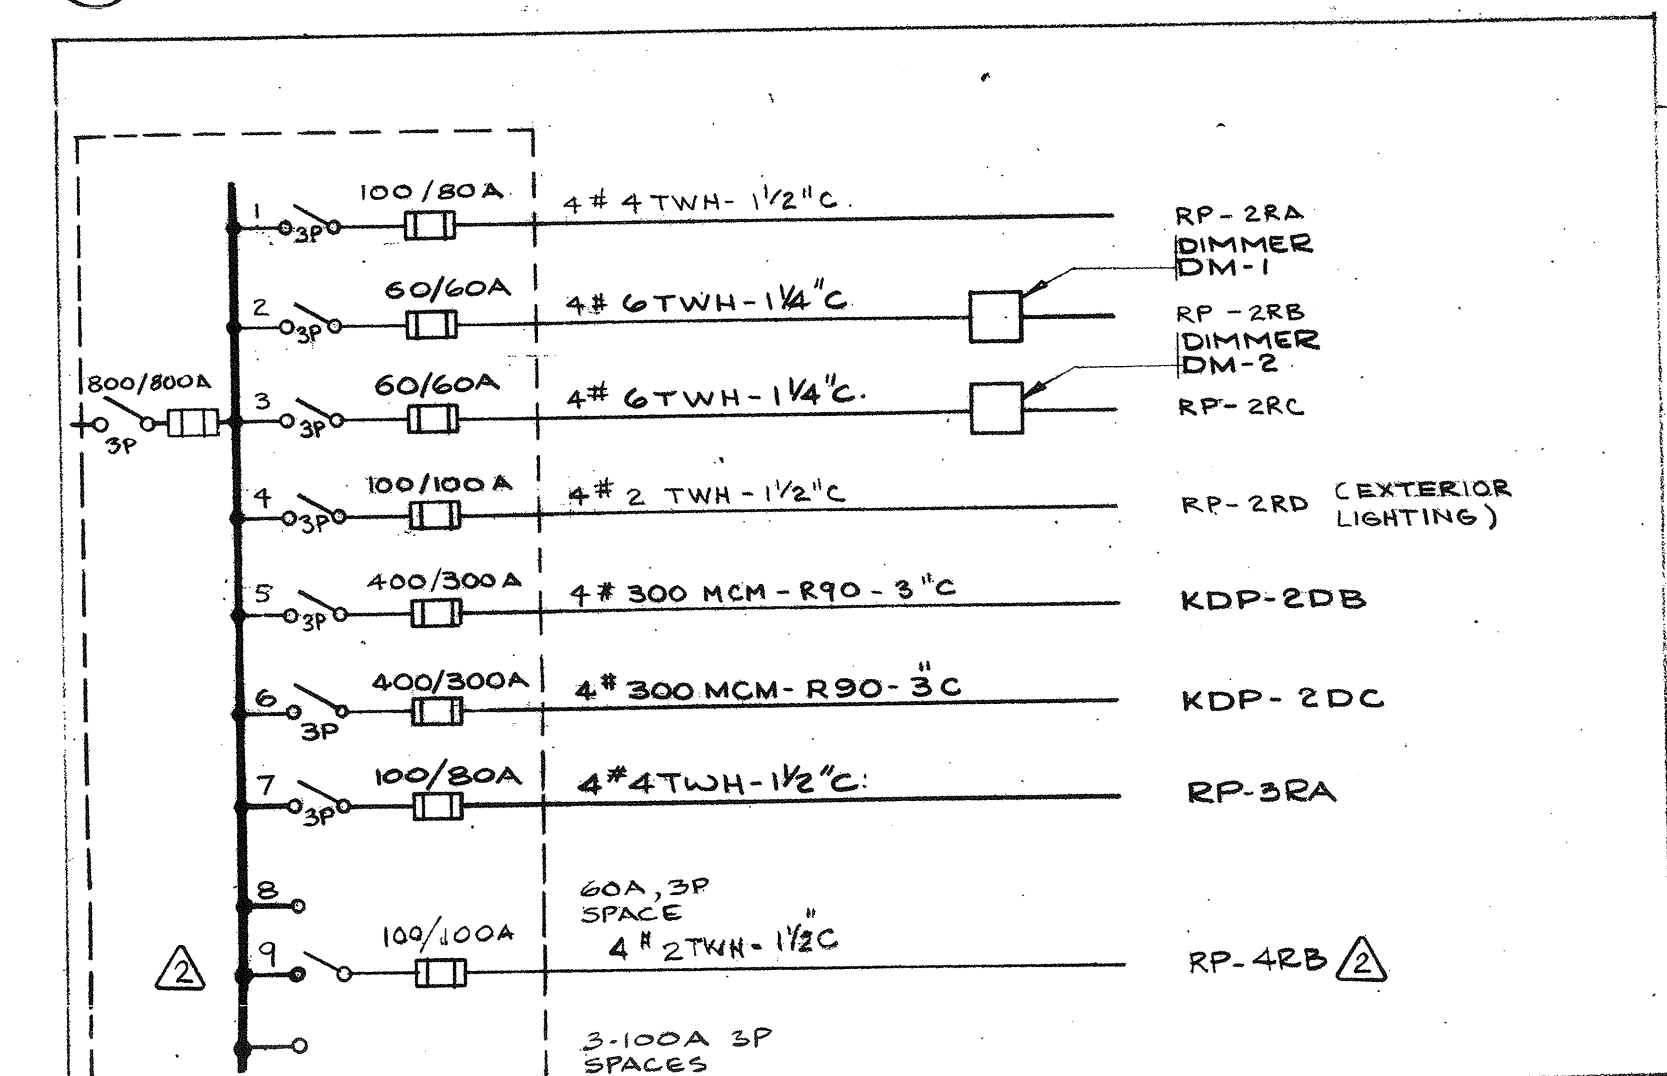


⑨ DP-2DA (120/208V, 3Ø, 4W, 800A. MAINS)

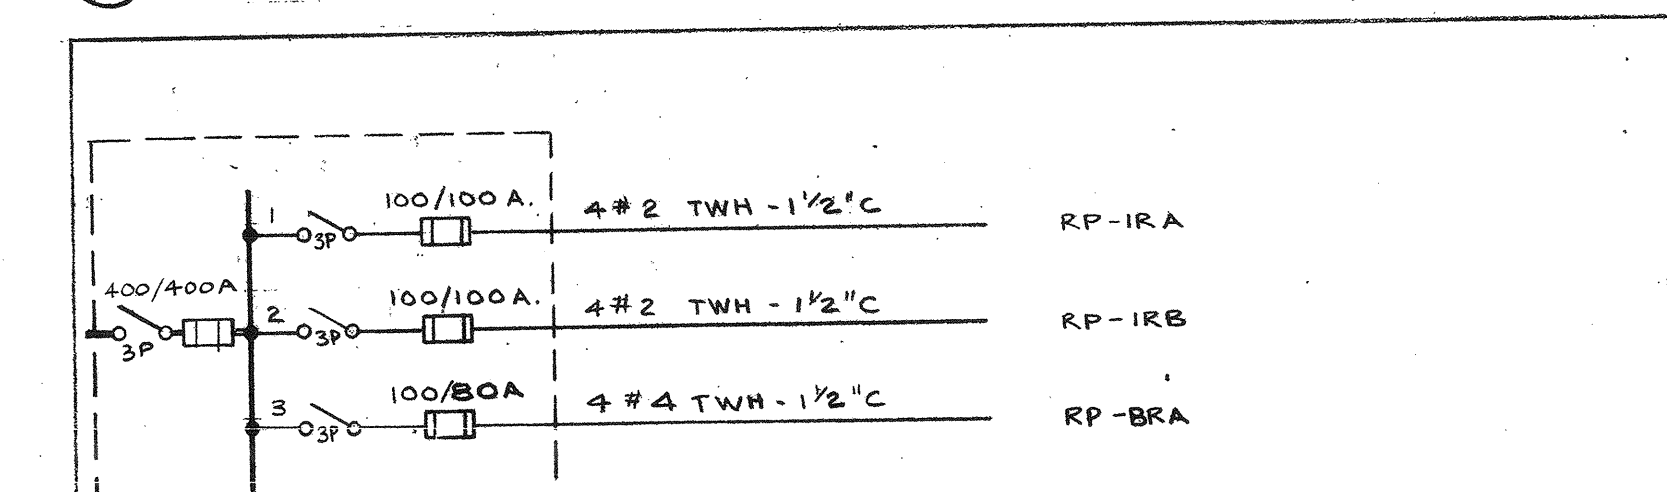


⑩ DP-IDA (120/208V, 3Ø, 4W, 400A. MAINS)

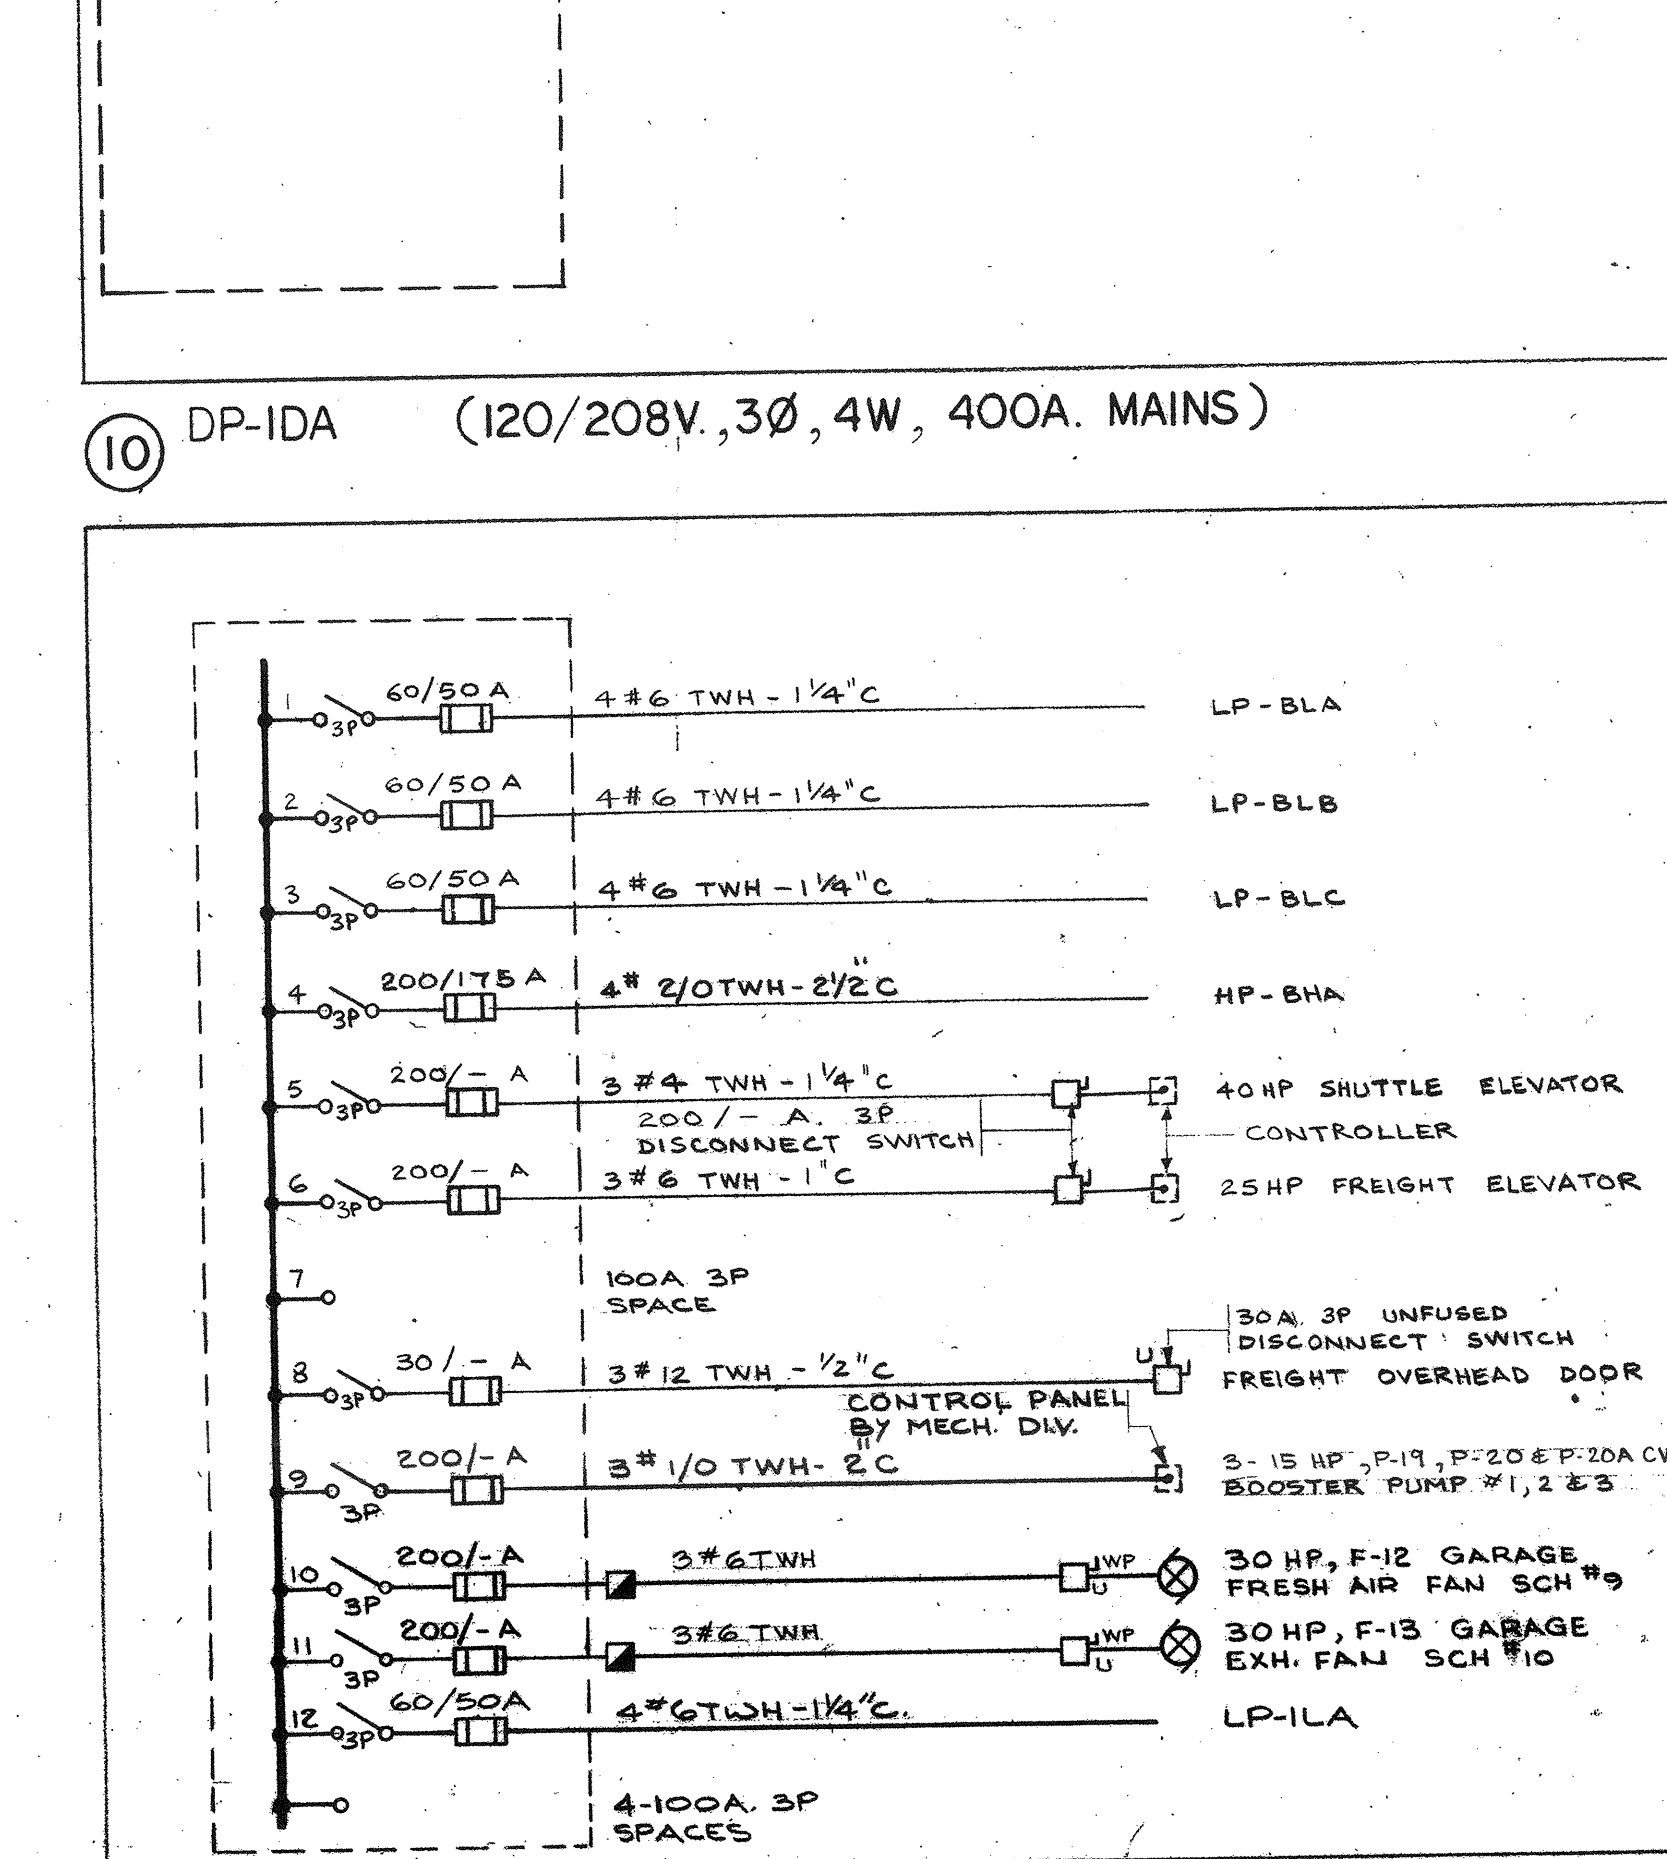


⑪ DP-BDA (240/416V, 3Ø, 4W, 600A. MAINS)

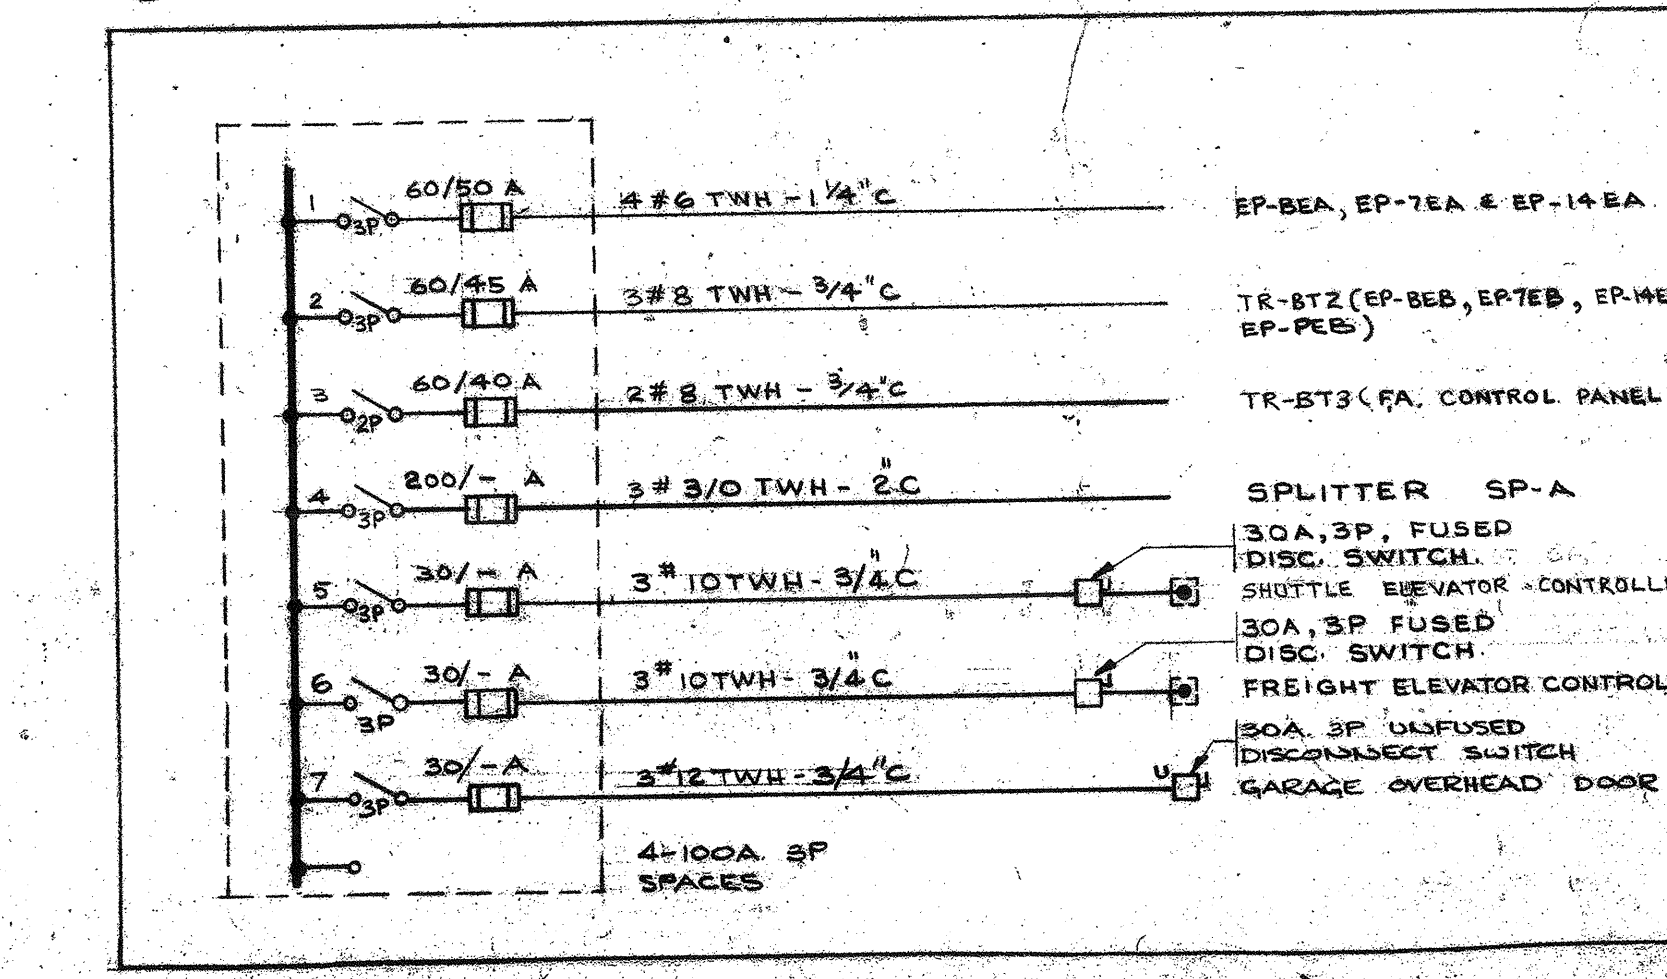


⑫ EDP-BDB (240/416V, 3Ø, 4W, 200A. MAINS)

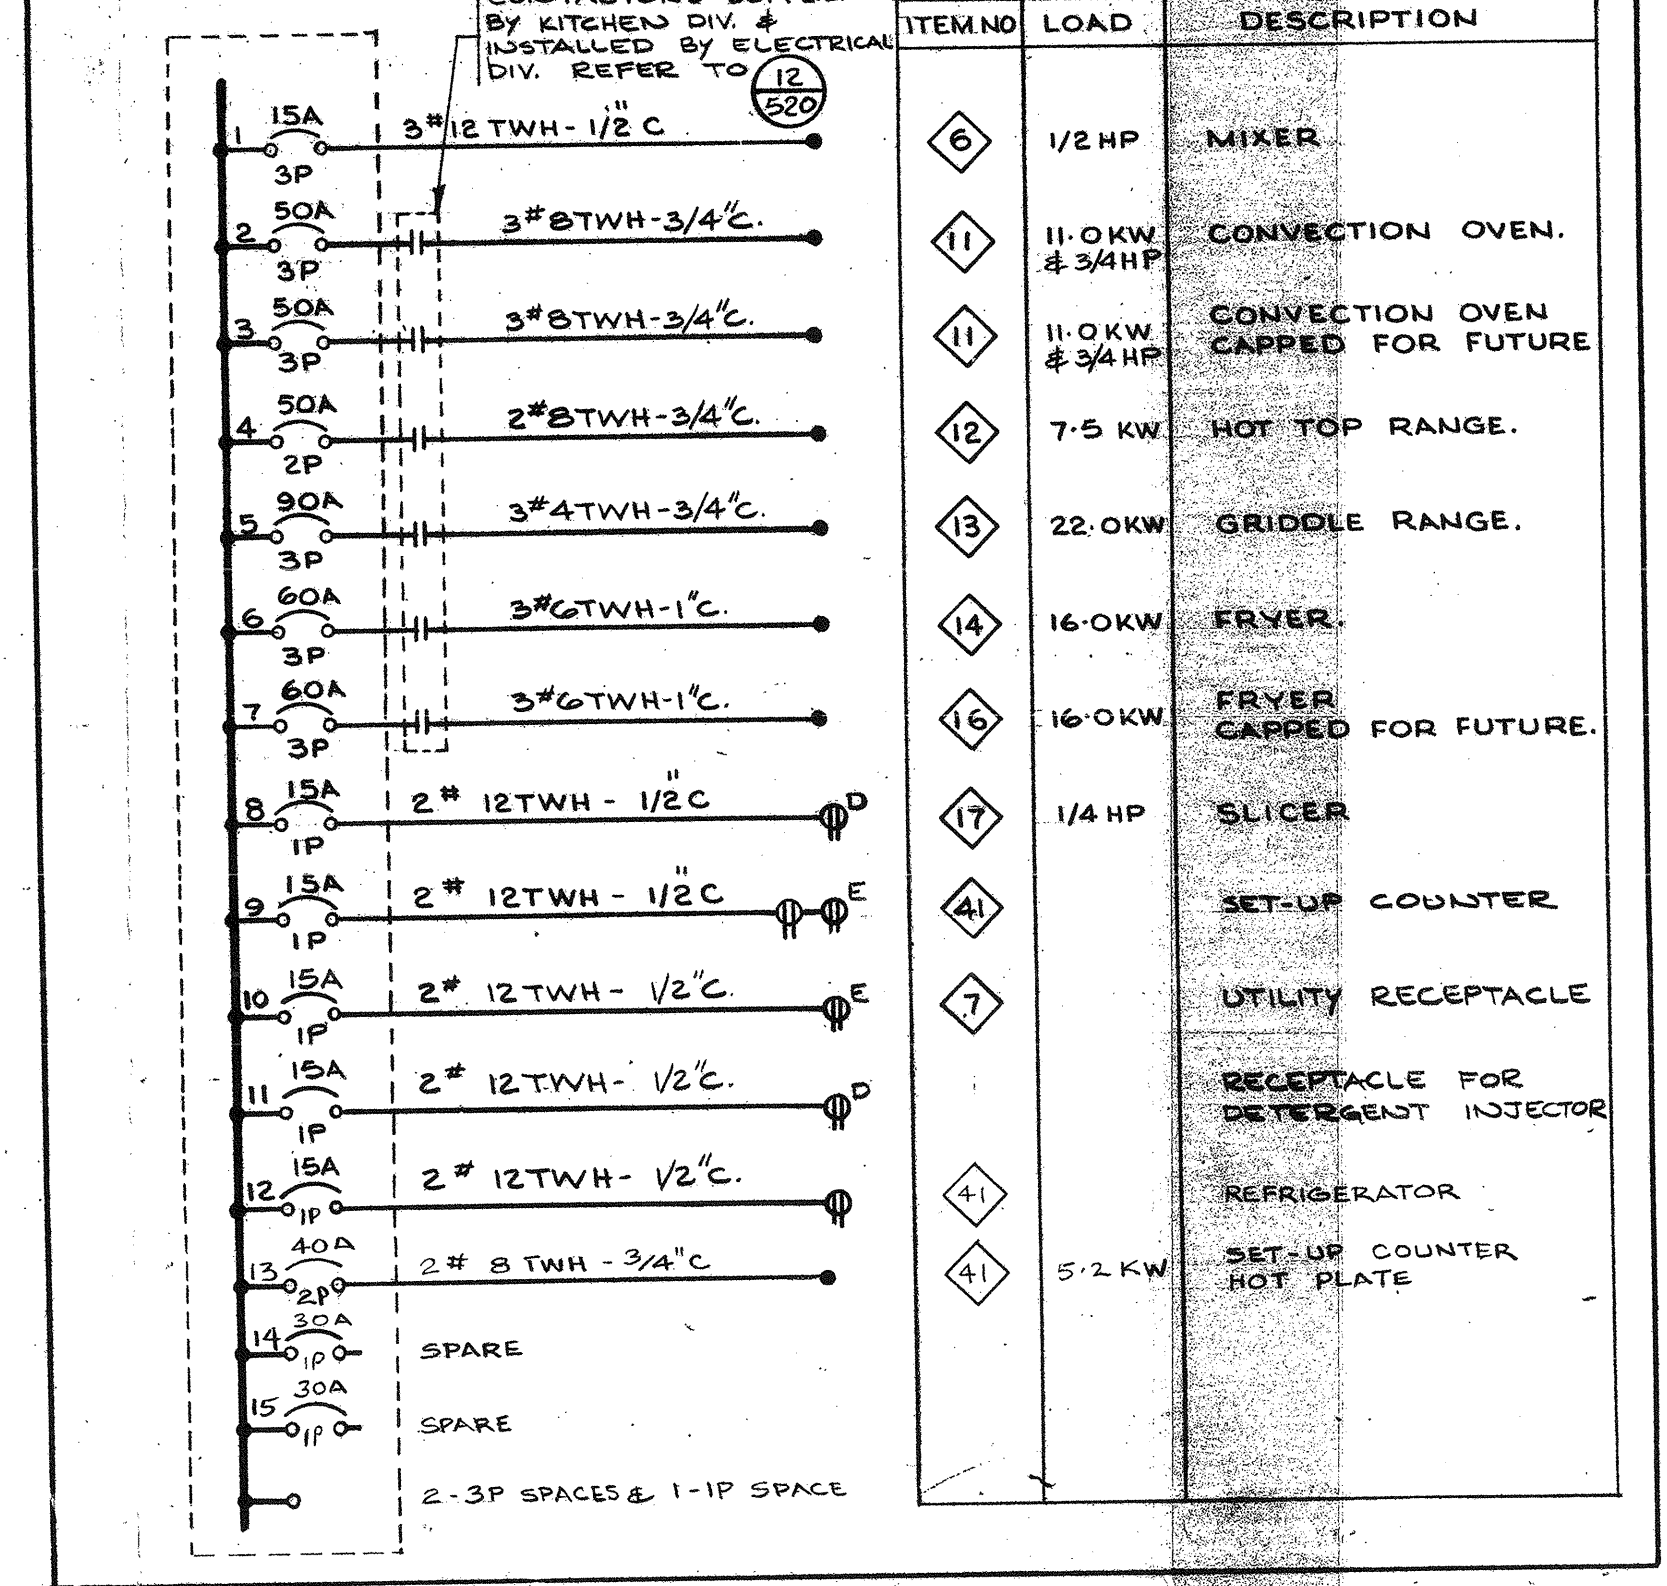


⑬ KDP-2DB (120/208V, 3Ø, 4W, 400A. MAINS)

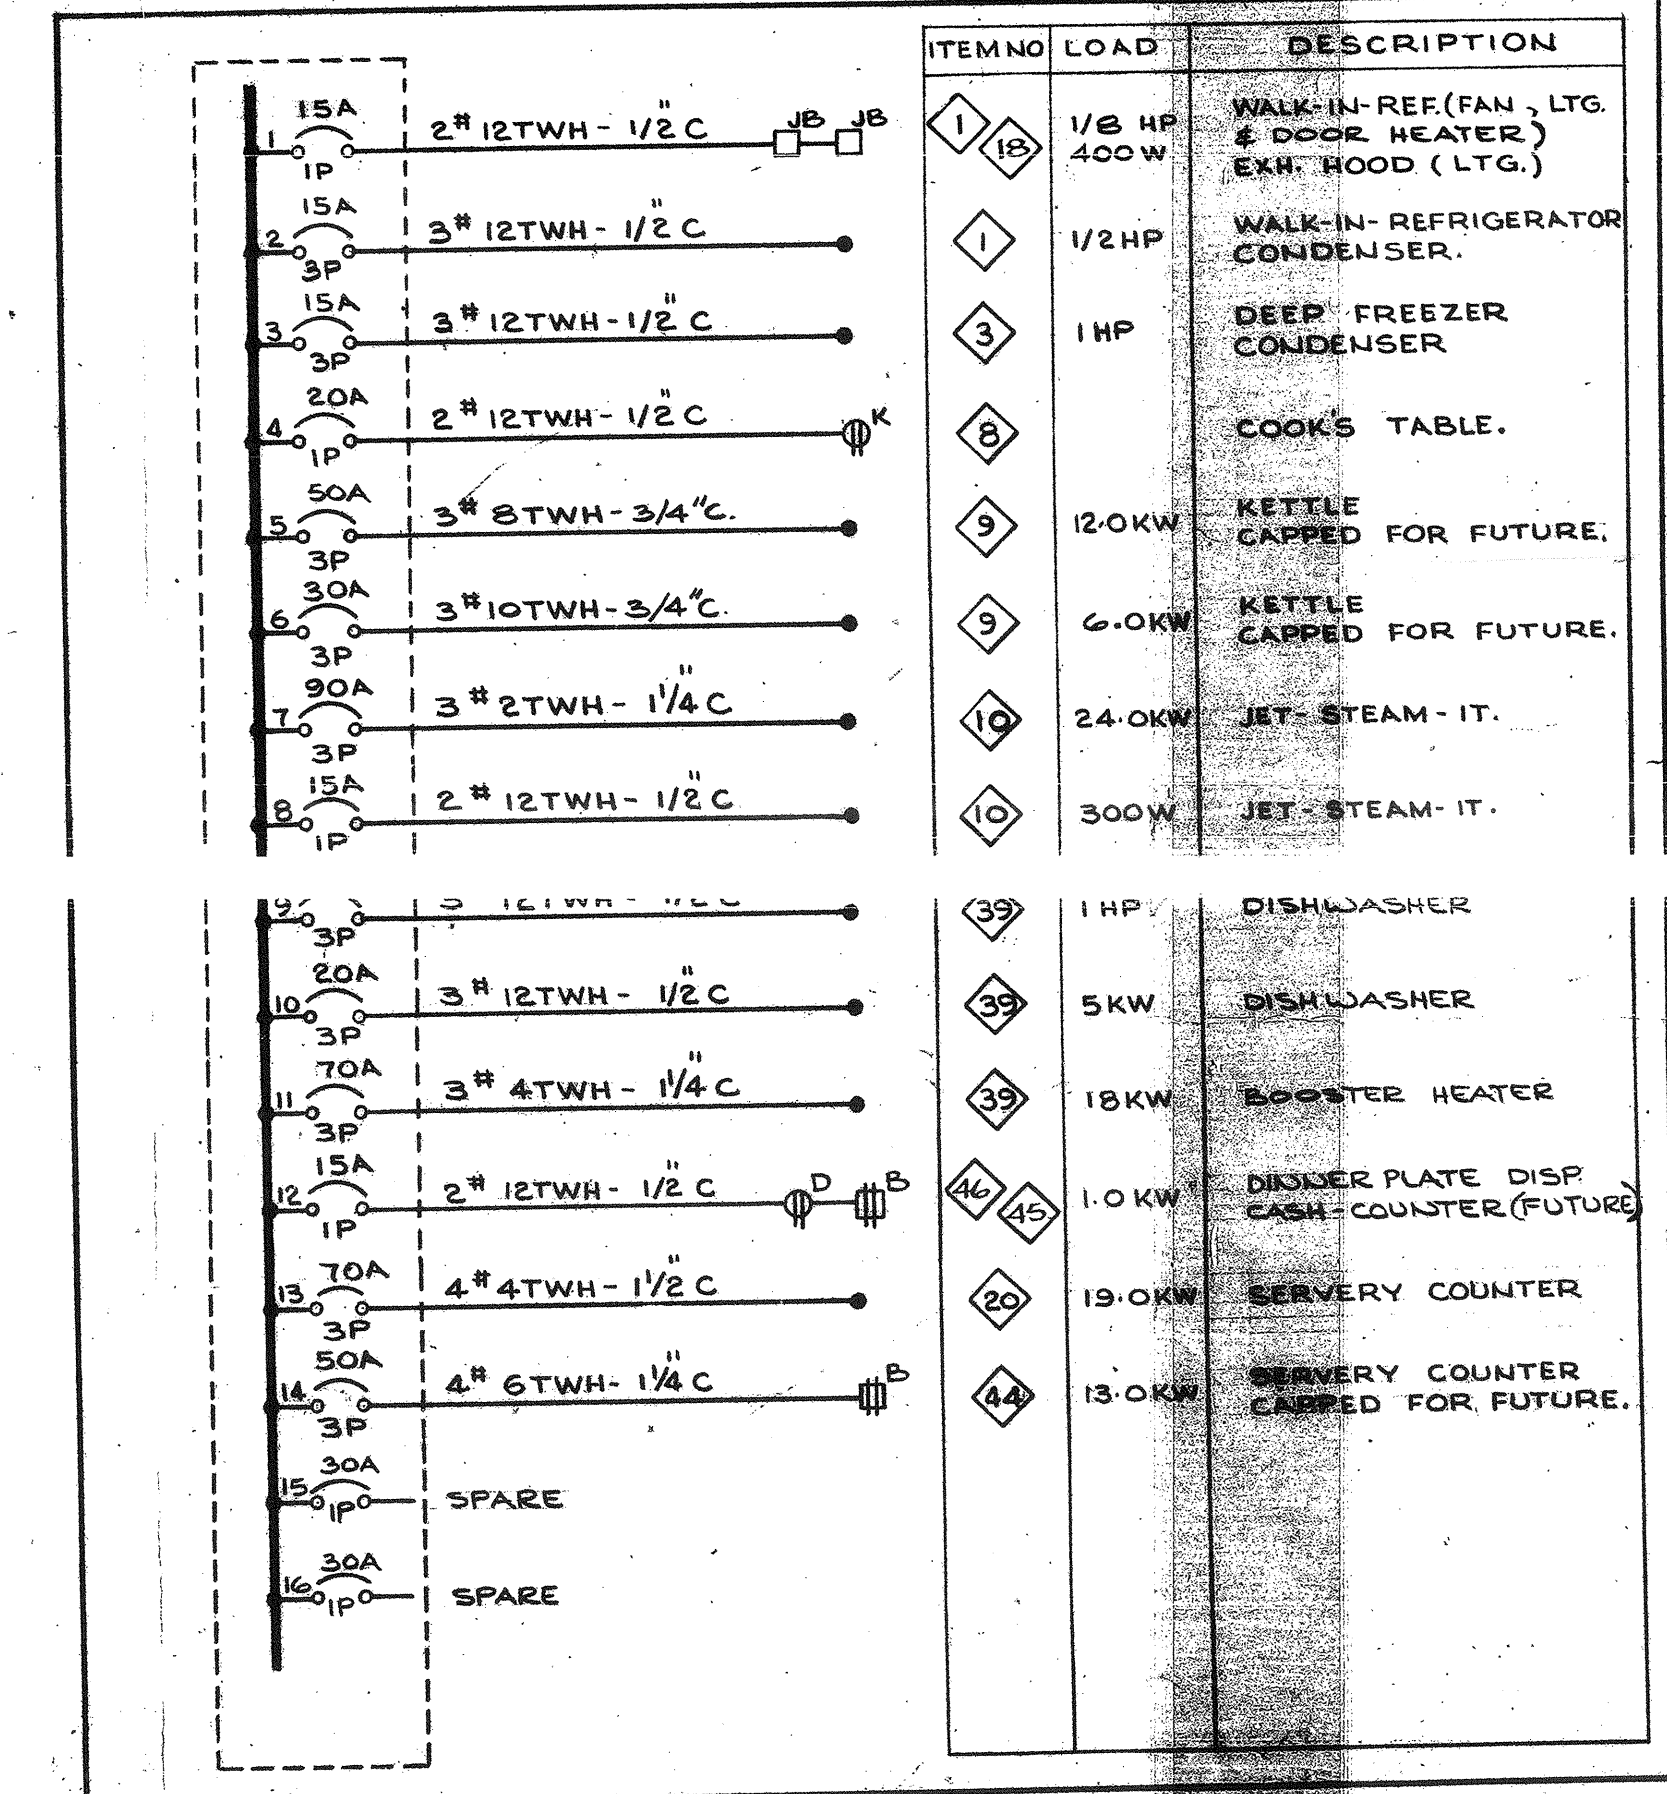

⑭ KDP-2DC (120/208V, 3Ø, 4W, 400A. MAINS)

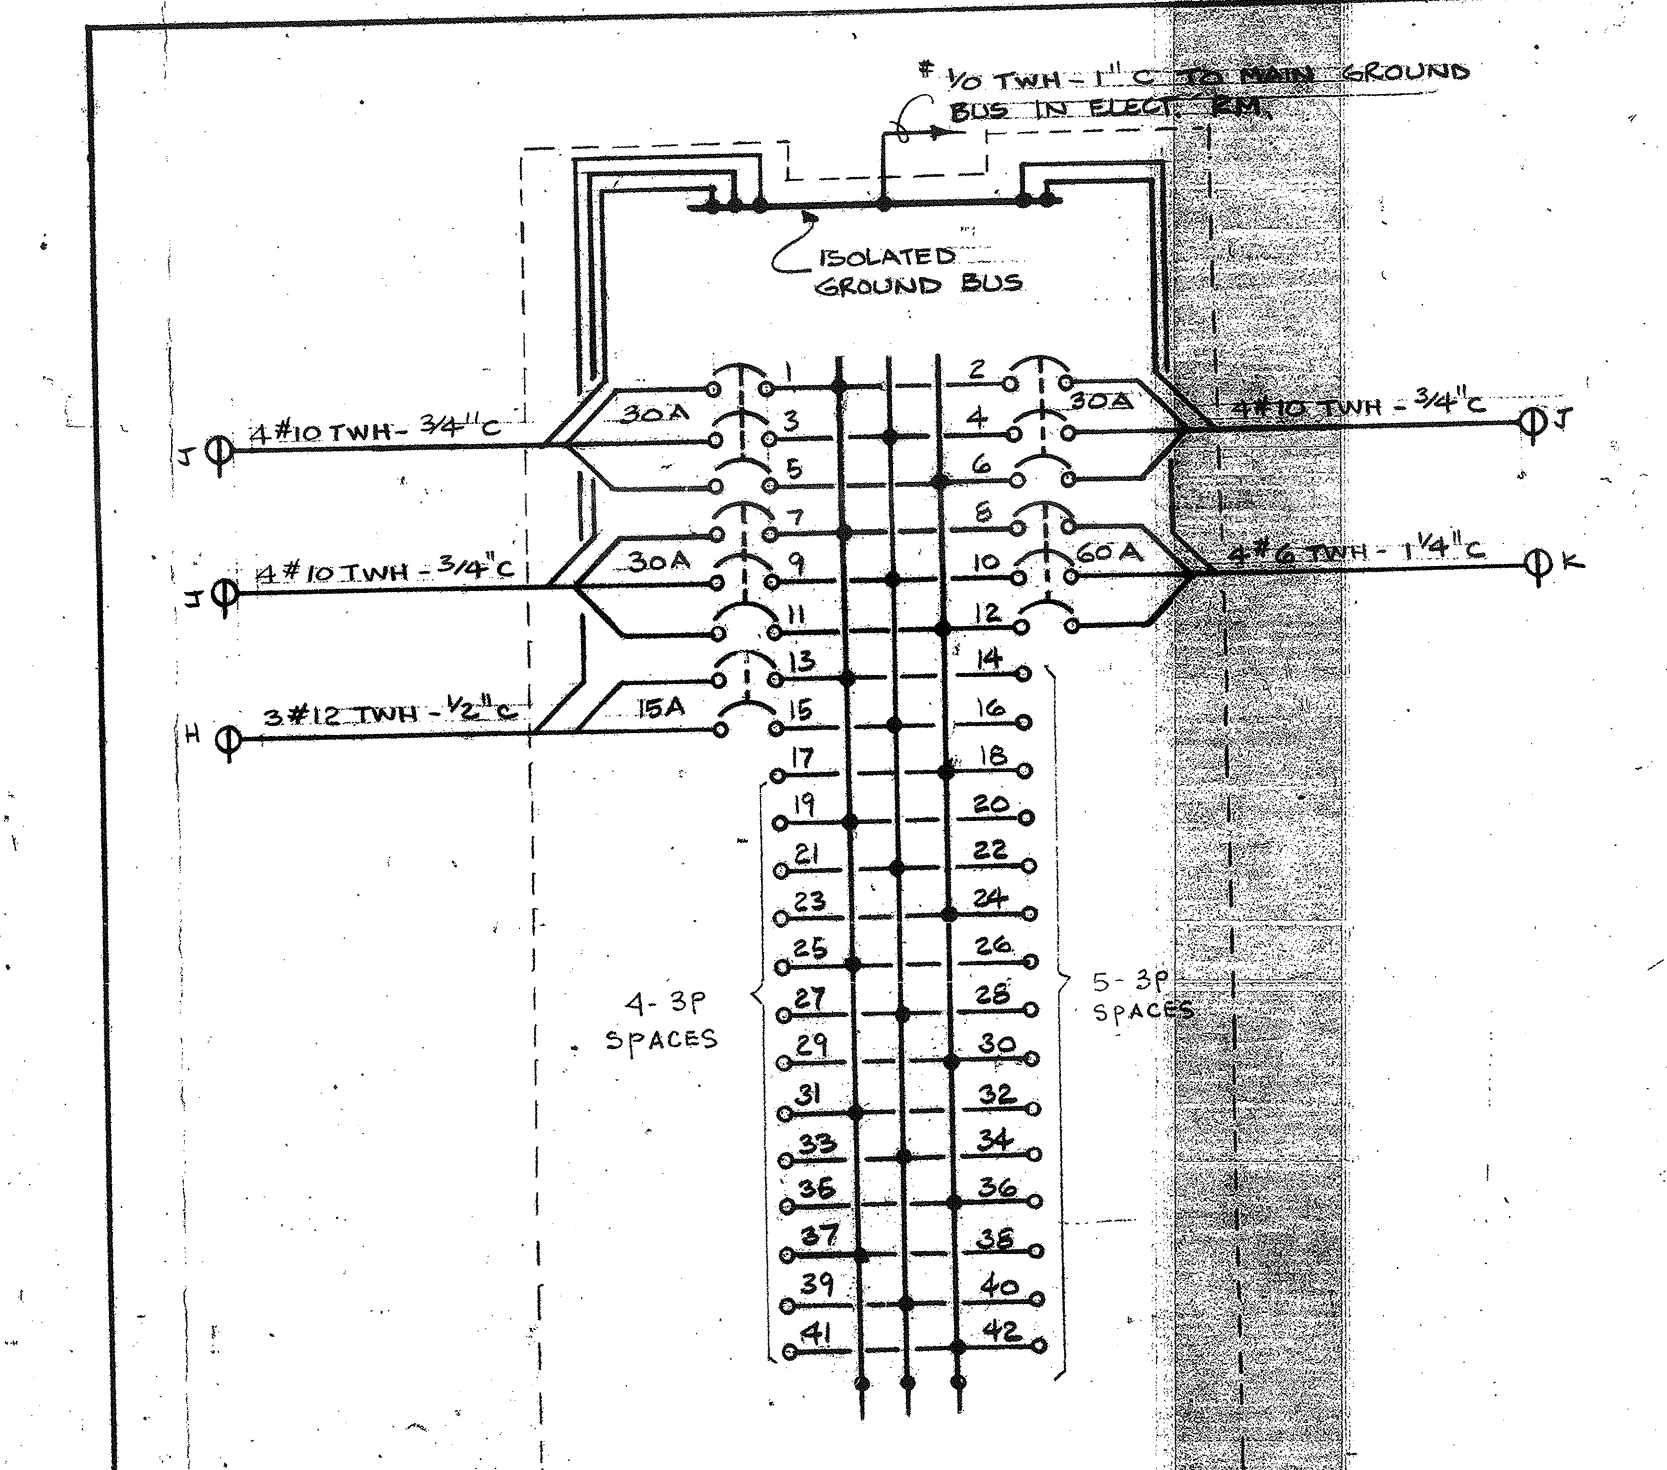

⑮ CP-4CA (120/208V, 3Ø, 4W, 400A. MAINS)

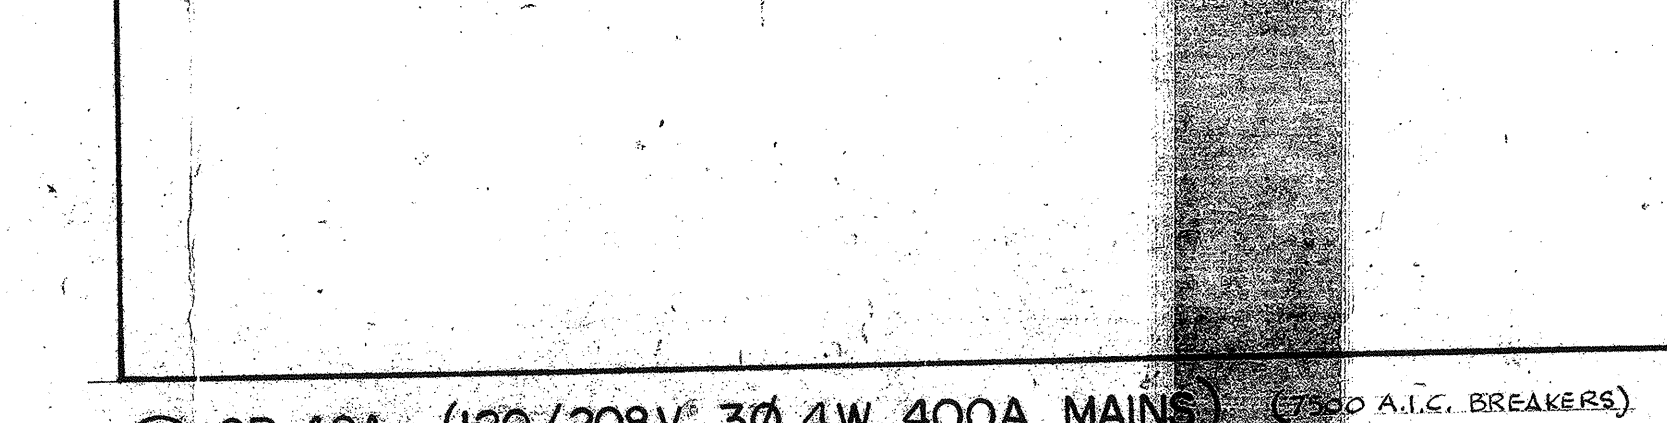

5. APPROVED FOR CONSTRUCTION BY THE CITY OF TORONTO
6. APPROVED FOR CONSTRUCTION BY THE CITY OF TORONTO
7. APPROVED FOR CONSTRUCTION BY THE CITY OF TORONTO

Revisions

Rev.	Description	Date	Ch'd
1	REVISIONS		
2	REVISIONS		
3	REVISIONS		
4	REVISIONS		
5	REVISIONS		
6	REVISIONS		
7	REVISIONS		
8	REVISIONS		
9	REVISIONS		
10	REVISIONS		
11	REVISIONS		
12	REVISIONS		
13	REVISIONS		
14	REVISIONS		
15	REVISIONS		
16	REVISIONS		
17	REVISIONS		
18	REVISIONS		
19	REVISIONS		
20	REVISIONS		
21	REVISIONS		
22	REVISIONS		
23	REVISIONS		
24	REVISIONS		
25	REVISIONS		
26	REVISIONS		
27	REVISIONS		
28	REVISIONS		
29	REVISIONS		
30	REVISIONS		
31	REVISIONS		
32	REVISIONS		
33	REVISIONS		
34	REVISIONS		
35	REVISIONS		
36	REVISIONS		
37	REVISIONS		
38	REVISIONS		
39	REVISIONS		
40	REVISIONS		
41	REVISIONS		
42	REVISIONS		
43	REVISIONS		
44	REVISIONS		
45	REVISIONS		
46	REVISIONS		
47	REVISIONS		
48	REVISIONS		
49	REVISIONS		
50	REVISIONS		

DATE: 11/1/71

NATIONAL LIFE OF CANADA

Head Office Building
University Avenue, Toronto, Canada

Searle Wilbee Rowland

Architects
Engineers
Planners
Toronto
Canada

ELECTRICAL
PANEL SCHEDULE
AND DISTRIBUTION
PANELS DETAILS

ONE

69039-517