


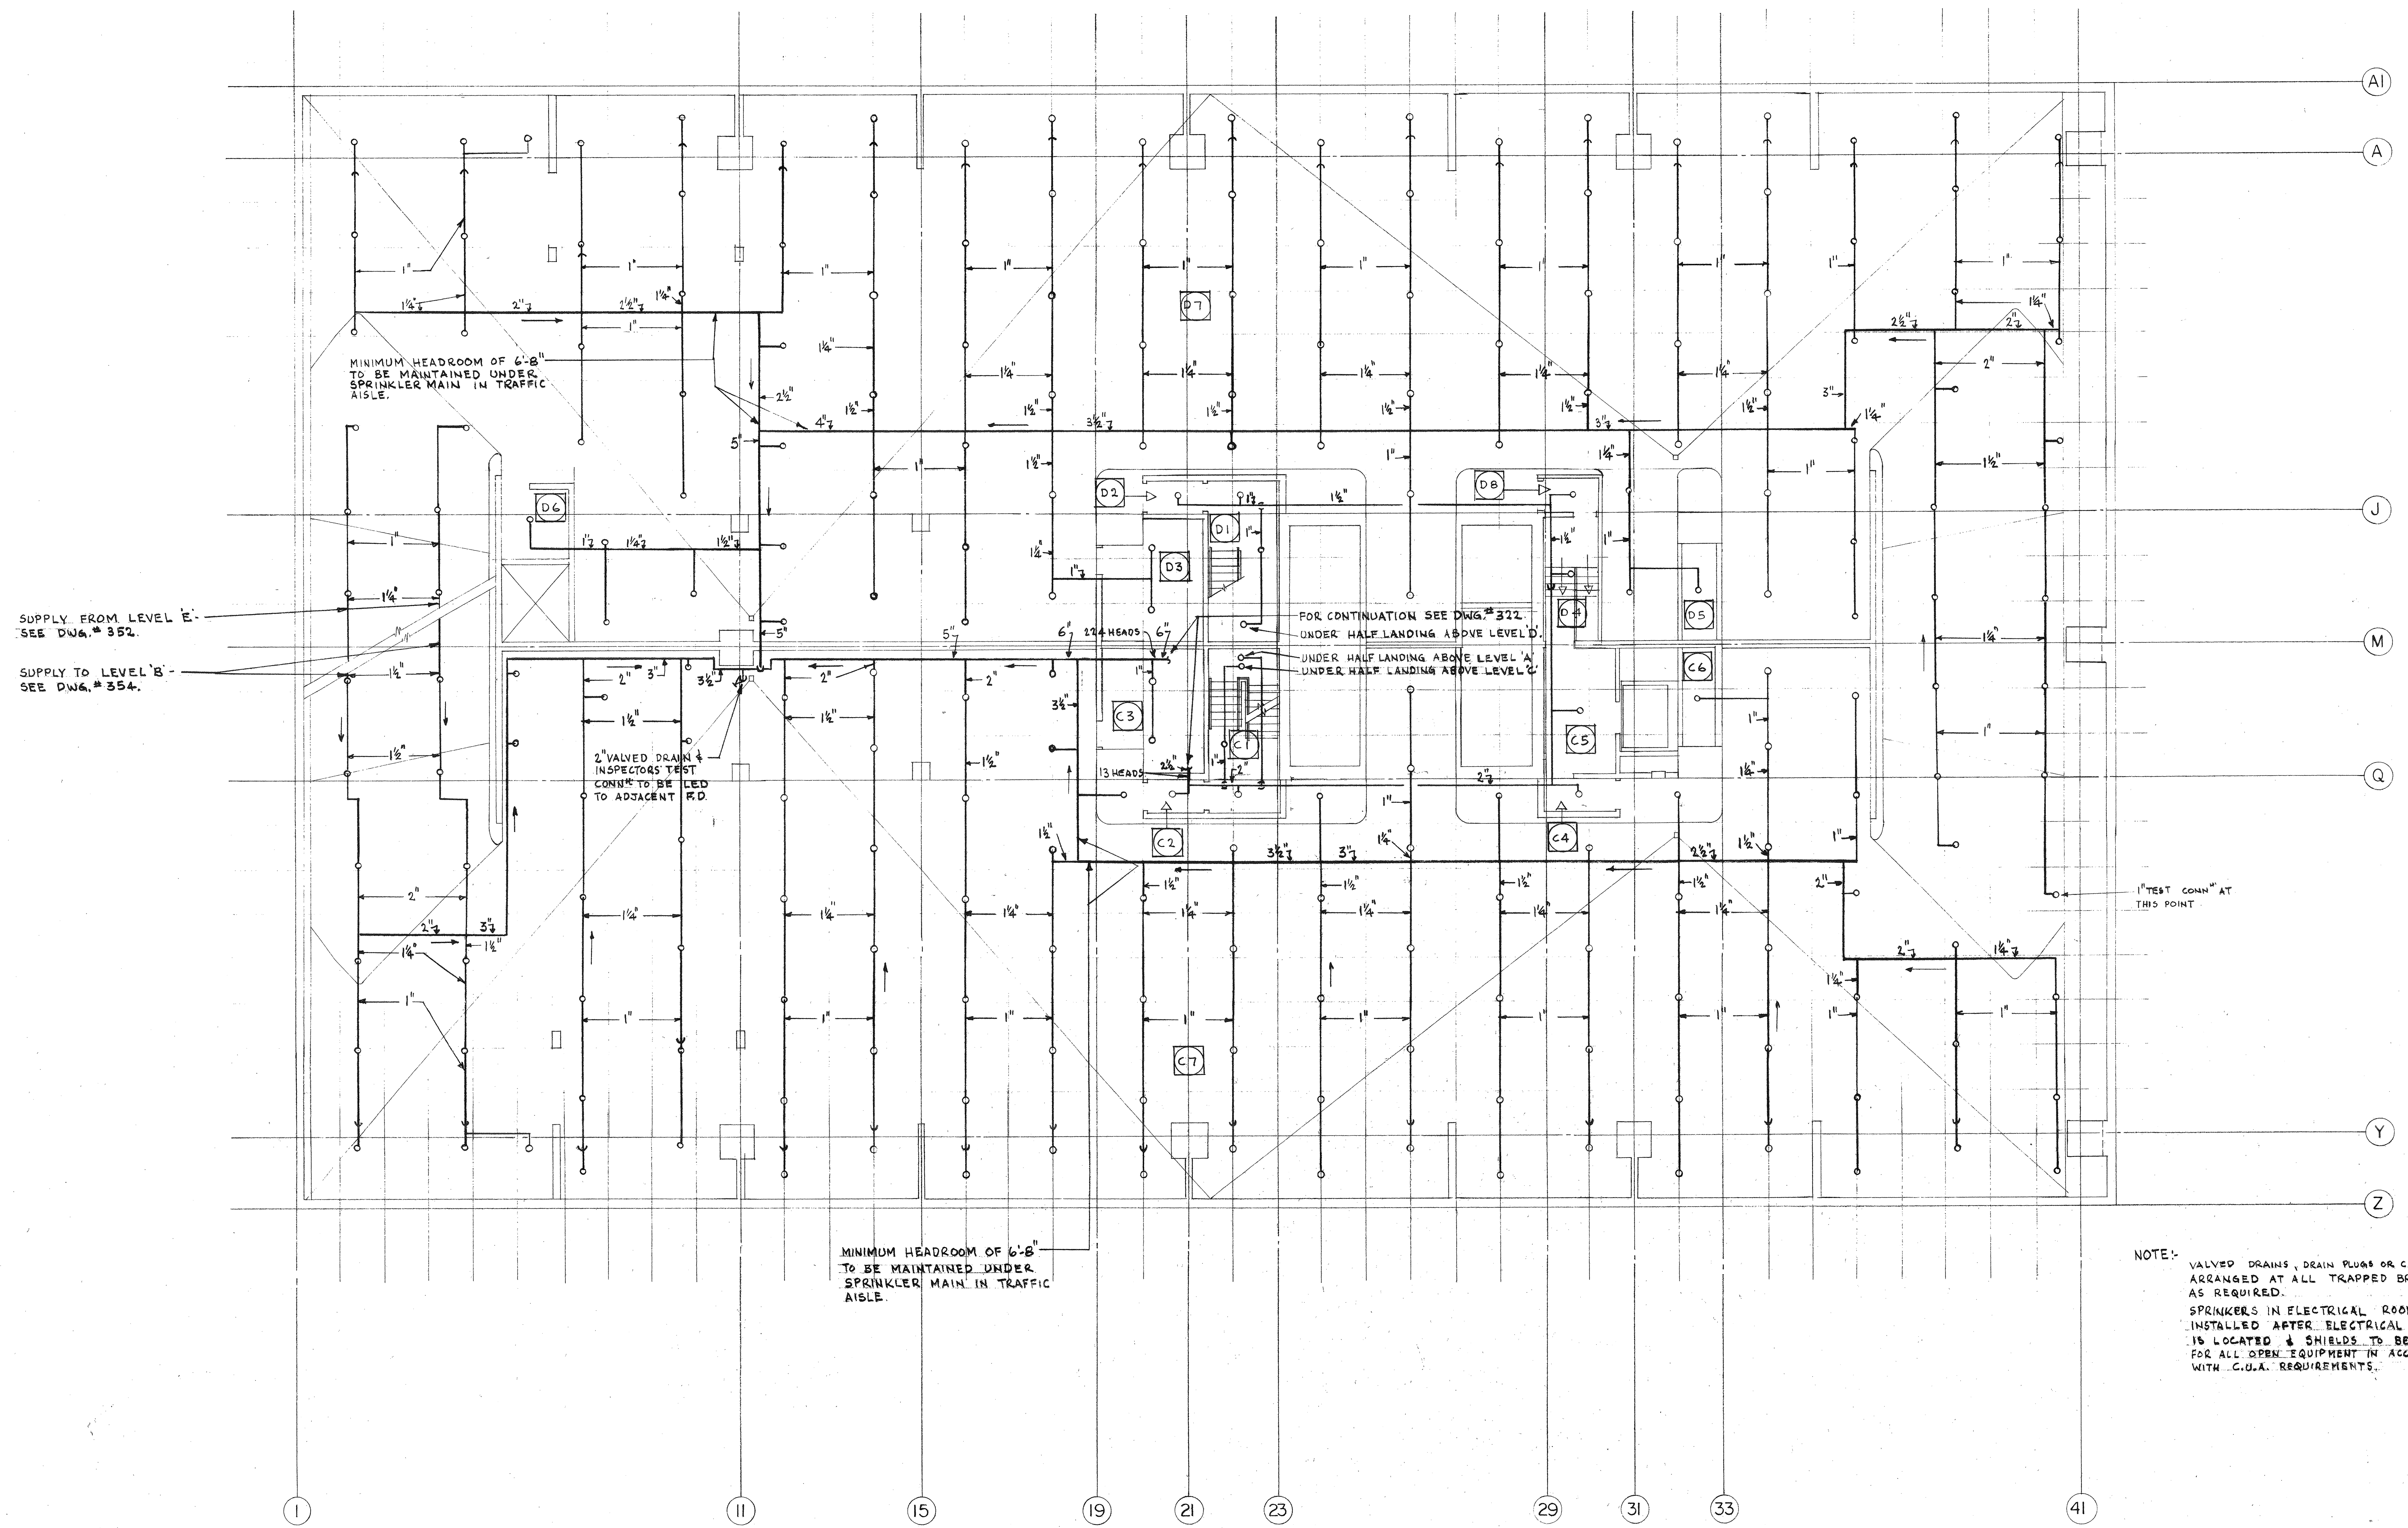

NOTE:- VALVED DRAINS, DRAIN PLUGS OR CAPS TO BE ARRANGED AT ALL TRAPPED BRANCHES AS REQUIRED.
SPRINKLERS IN ELECTRICAL ROOMS TO BE INSTALLED AFTER ELECTRICAL EQUIPMENT IS LOCATED & SHIELDS TO BE PROVIDED FOR ALL OPEN EQUIPMENT IN ACCORDANCE WITH C.O.A. REQUIREMENTS.

No.	Ref.	Description	Date	Ch'd
Revisions				
Drawn S.S.				
Date 2 FEB 1971				
Checked A.L.				
Pro-Design PW				
Design JAK				
Structural BU				
Heating AL				
Sanitary AL				
Electrical CA				
Specifications RX				
Process				
Printed				

All measurements must be checked on the work by the contractor.
All prints and specifications are the property of the architect and must be returned at the completion of the work.
This drawing not to be used for construction purposes until countersigned by:
Date

NATIONAL LIFE OF CANADA
Head Office Building
University Avenue, Toronto, Canada

Parkin Searle Wilbee Rowland
Architects
Engineers
Planners

Sheet Title	SPRINKLERS PARKING LEVELS D & C
Scales	1/8" = 1'-0"
Sheet Number	69039-353