



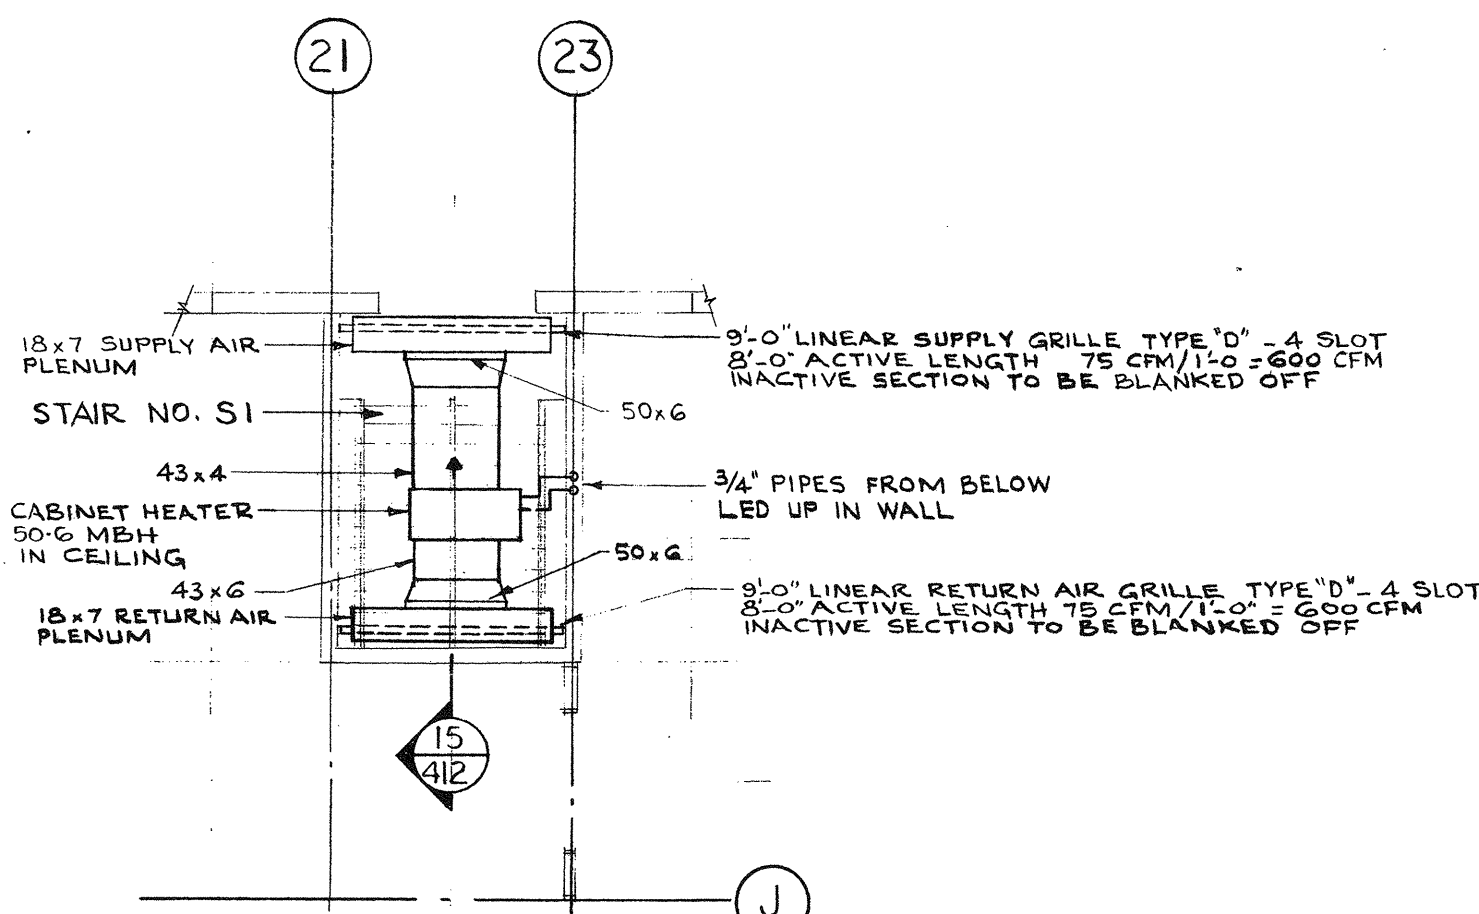

PART PLAN - STAIR NO. S1
SCALE: 1/8" = 1'-0"

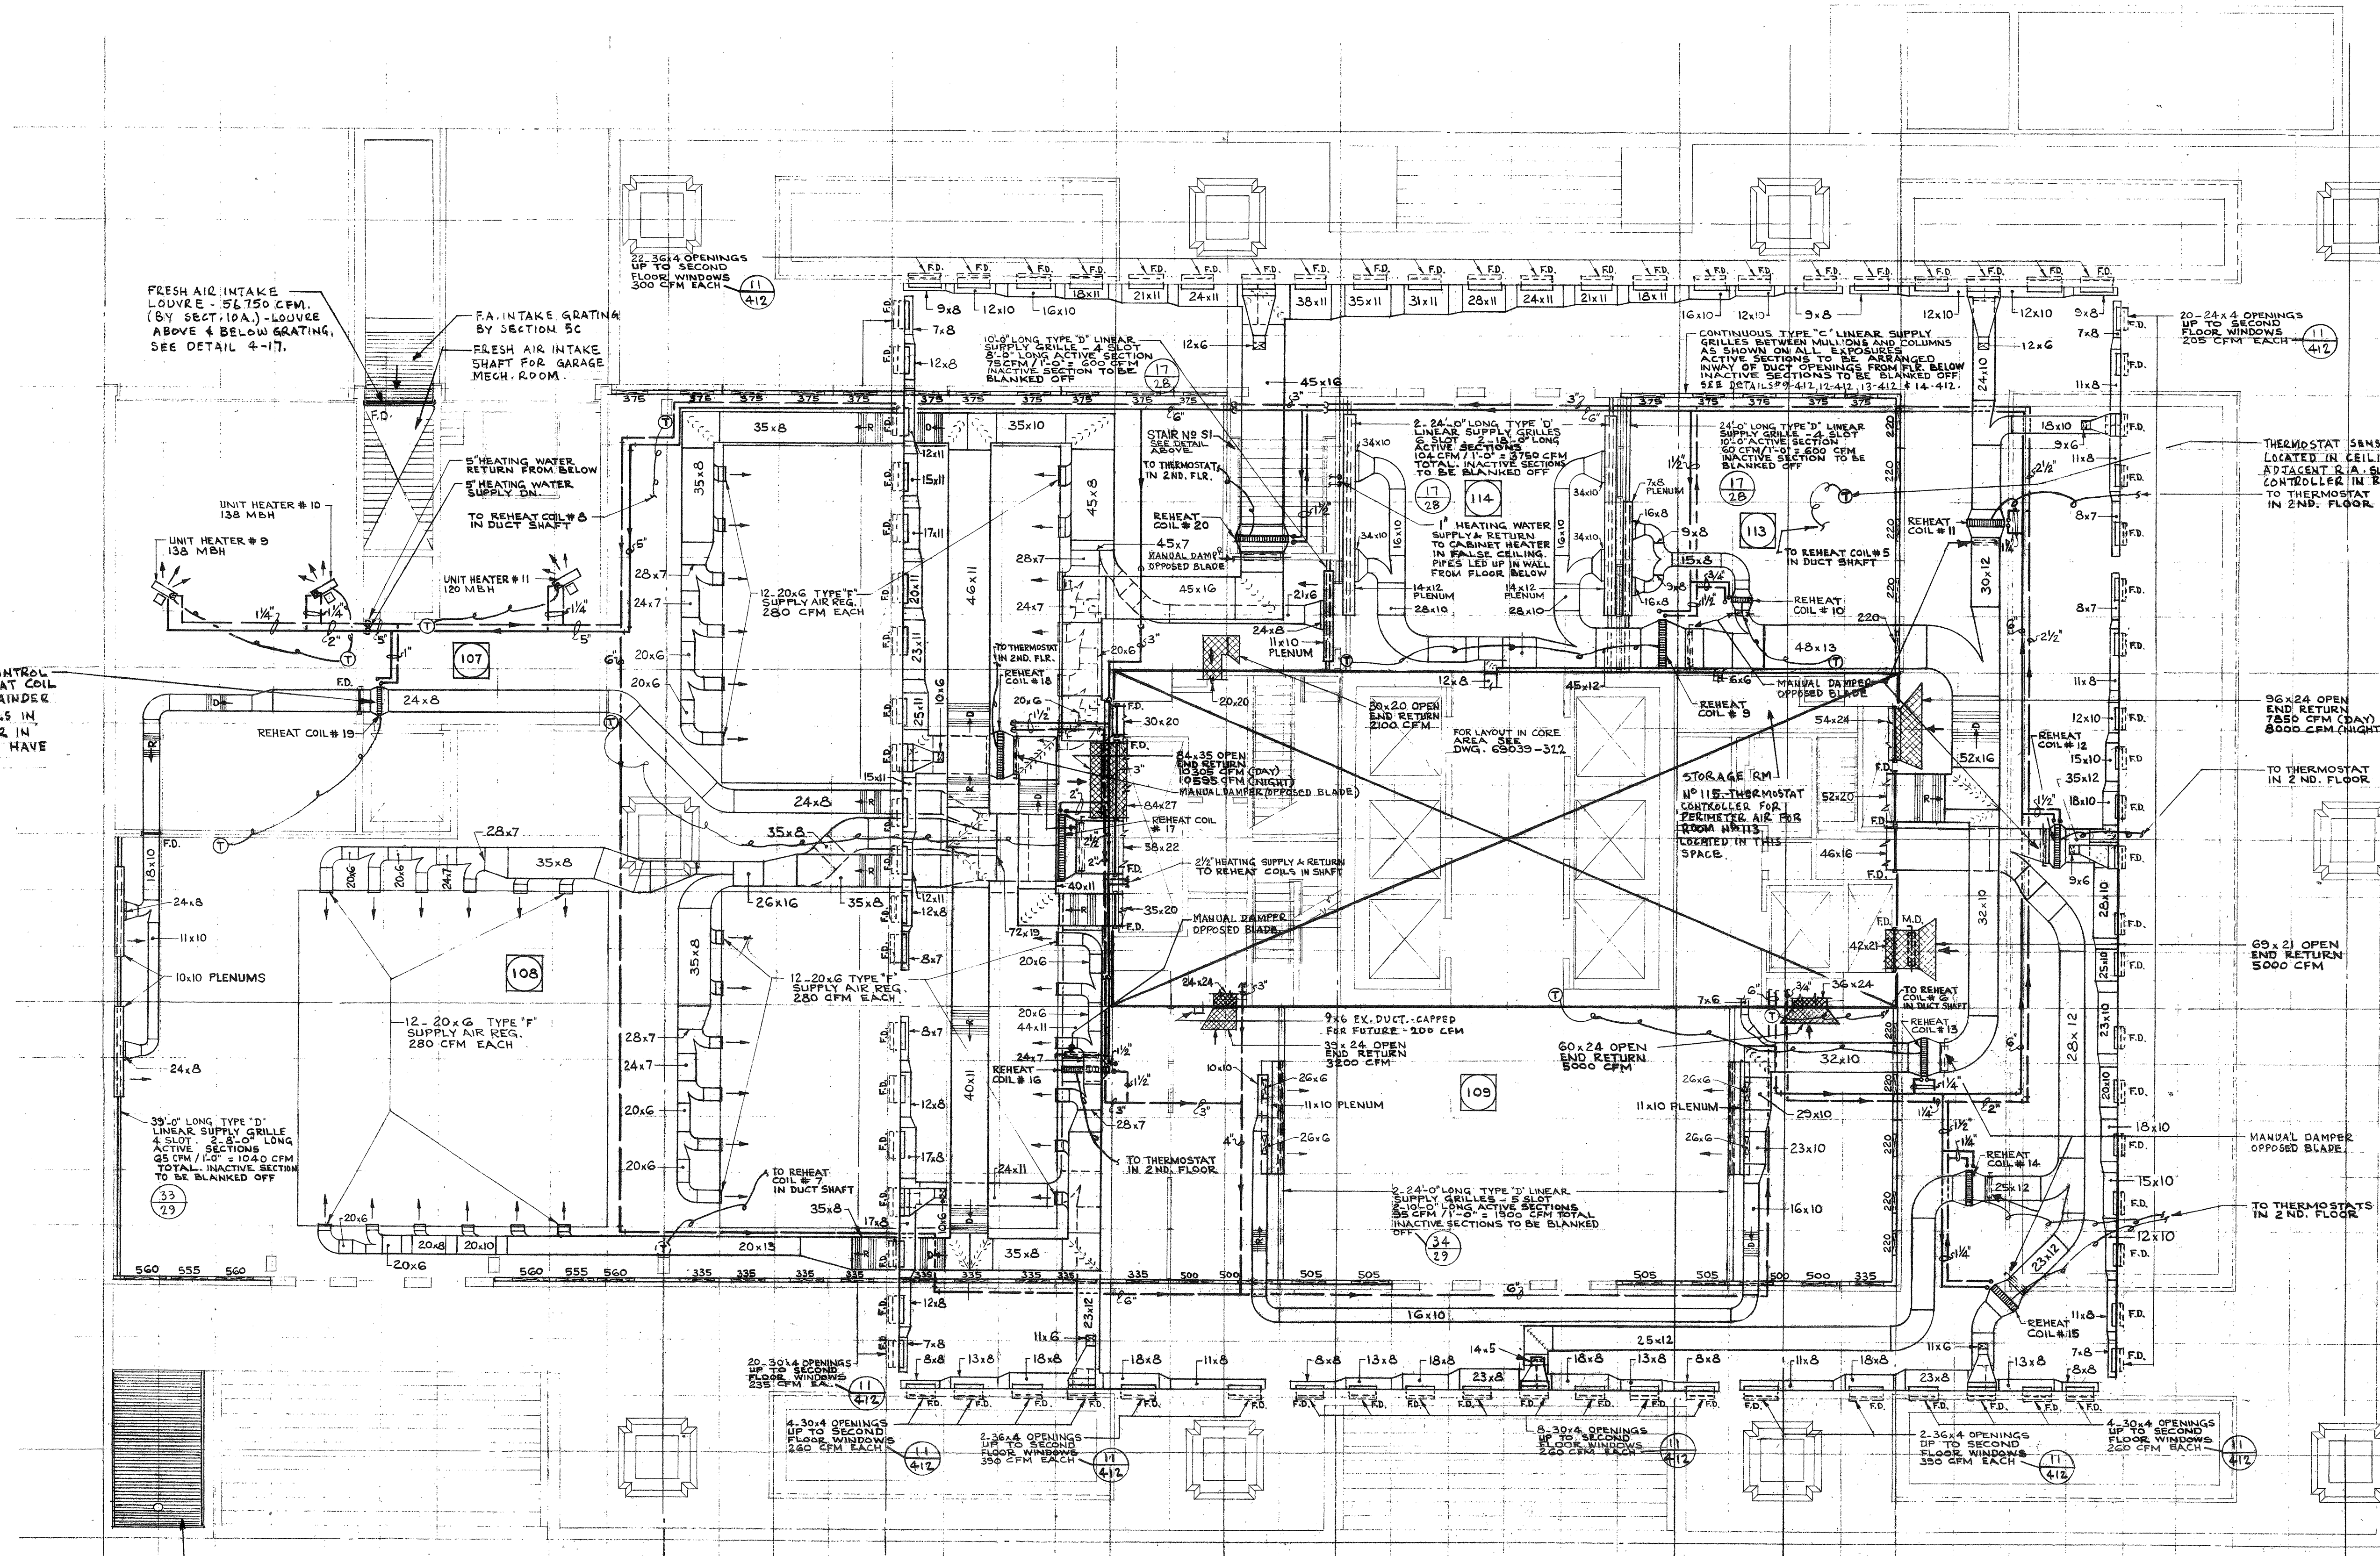

NOTE:
REGRESSED SLOT ROUND WALLS FOR RETURNING AIR TO CEILING PLENUMS. SLOT BLANKED OFF IN WAY OF RETURN AIR DUCTS IN CEILING - SEE DETAILS 11-12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 64, 65, 66, 67, 68, 69, 70, 71, 72, 73, 74, 75, 76, 77, 78, 79, 80, 81, 82, 83, 84, 85, 86, 87, 88, 89, 90, 91, 92, 93, 94, 95, 96, 97, 98, 99, 100.
FOR APPROX. LOCATION OF CEILING ACCESS PANELS FOR REHEAT COILS ETC. SEE DRAWING NO. 80.

THE LOCATION OF EQUIPMENT, SUCH AS LIGHTING FIXTURES, SPRINKLER HEADS, AIR DIFFUSERS, IS SHOWN IN DIAGRAM-MATIC FORM. THE EXACT LOCATION OF ALL SUCH EQUIPMENT SHALL BE CO-ORDINATED BY THE CONTRACTOR TO CONFORM TO THE OVERALL CEILING PATTERN. THE CONTRACTOR SHALL ENSURE THAT THE LOCATIONS ARE APPROVED BY THE ARCHITECT BEFORE THE EQUIPMENT IS INSTALLED.

THE LOCATION OF EQUIPMENT SUCH AS SWITCHES, THERMOSTATS AND CON-TROLS IS SHOWN IN DIAGRAMMATIC FORM. THE CONTRACTOR SHALL COOR-DINATE THE EXACT LOCATION KEEPING ALL SUCH EQUIPMENT AS CLOSE TO DOOR JAMBS AND OTHER OPENINGS AS POSSIBLE. WHEN MOUNTED ON ROLLED STEEL COLUMNS ALL SUCH EQUIPMENT SHALL BE MOUNTED ON THE WEB OF THE COLUMN UNLESS NOTED OTHER-WISE. THE CONTRACTOR SHALL ENSURE THAT THE LOCATIONS ARE APPROVED BY THE ARCHITECT BEFORE THE EQUIP-MENT IS INSTALLED.

ALL METAL PARTS OF EQUIPMENT EX-POSED ON THE EXTERIOR OF THE BUILD-ING SHALL BE COORDINATED BY THE CONTRACTOR TO PRESERVE A UNIFORM COLOUR THROUGHOUT.

ALL DRAINAGE, VENT AND WATER PIP-ING SHALL BE CONCEALED IN PIPE SPACES, WALL CHASES OR FURRING EX-CEPT WHERE SHOWN AS EXPOSED.

FRESH AIR INTAKES WHERE REQUIRED FOR BUILDING TRAPS SHALL BE CON-CEALED IN CHASES OR FURRED IN EX-TERIOR WALLS. THE OUTLET SHALL BE COVERED BY A STAINLESS STEEL OR WHITE METAL PERFORATED GRILLE.

No.	Ref.	Description	Date	Ch'd
Revisions				
1		Drawn A.L.		
2		Date 5 FEB 1971		
3		Checked A.L.		
4		Pre-Design		
5		Design P.W.		
6		Architectural J.A.B.		
7		Structural B.U.		
8		Heating A.V.		
9		Sanitary A.V.		
10		Electrical C.A.		
11		Specifications R.K.		
12		Process		
13		Printed		

All measurements must be checked on the work by the contractor.
All prints and specifications are the property of the architect and must be returned at the completion of the work.
This drawing not to be used for construction purposes until countersigned by:
Date

NATIONAL LIFE OF CANADA
Head Office Building
University Avenue, Toronto, Canada

Parkin Searle Wilbee Rowland
Architects
Engineers
Planners

Sheet Title
Copyright ©
Scale 1/8" = 1'-0"
Sheet Number
AIR CONDITIONING GROUND FLOOR
69039-405