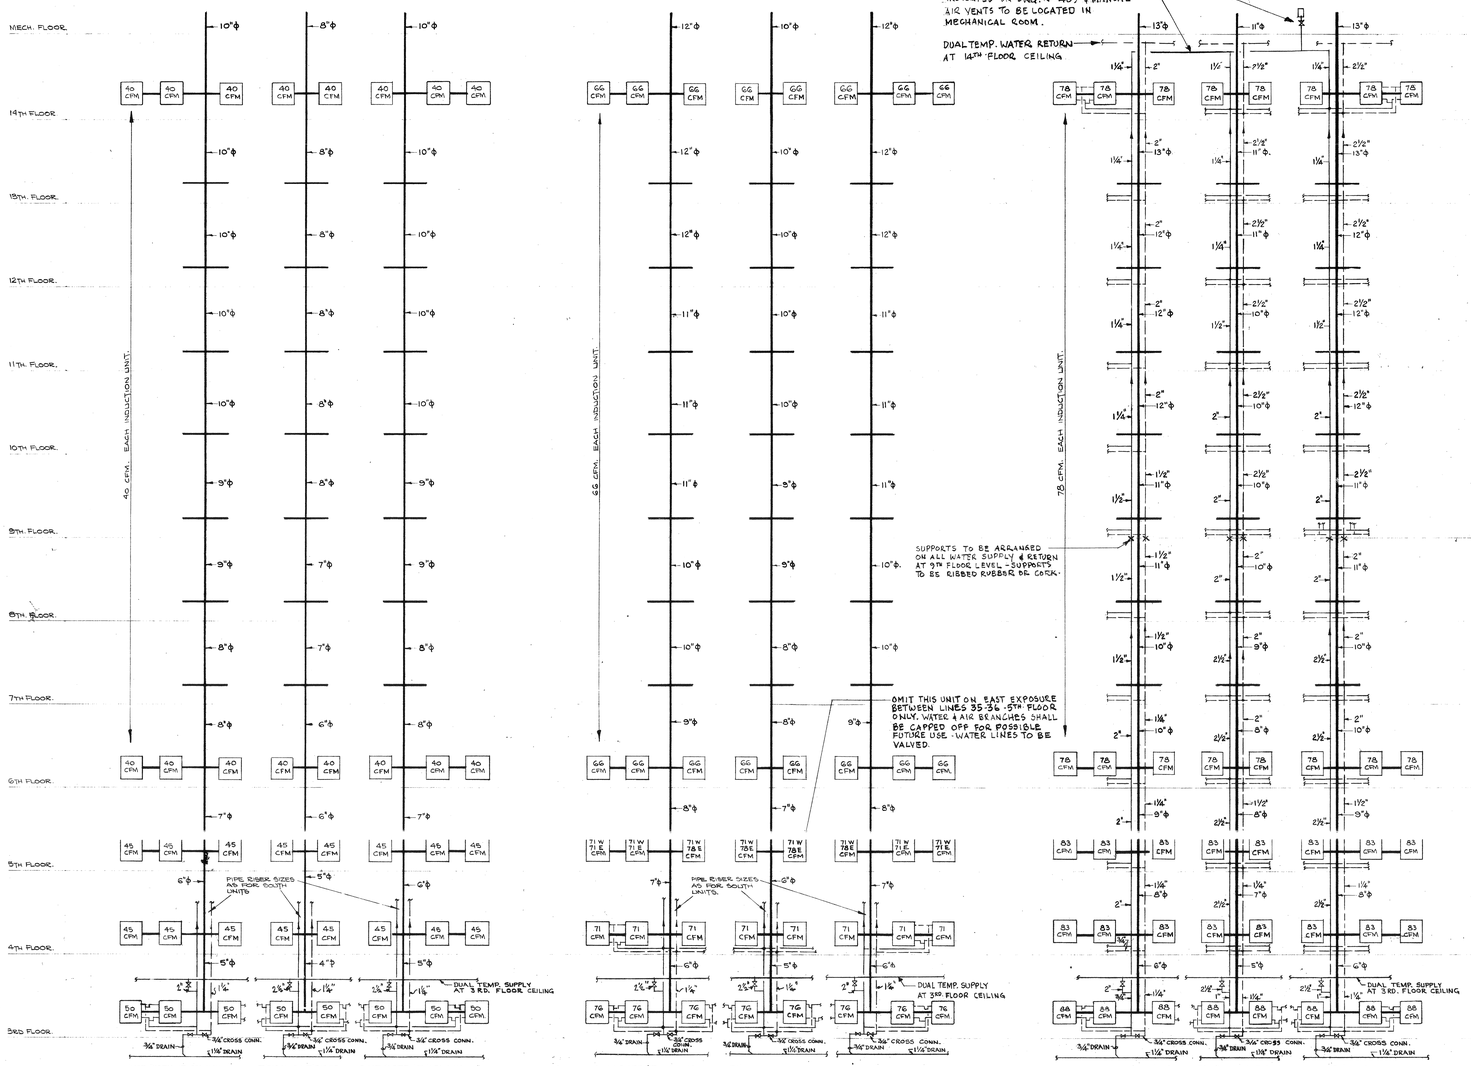

INDUCTION AIR UNIT DUCT AND PIPE RISERS.

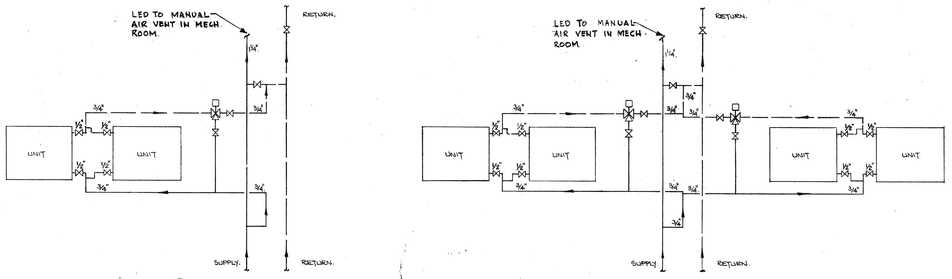

DETAIL (1)

DETAIL (2)

ARRANGEMENT OF PIPING TO INDUCTION UNITS ON 14TH. FLOOR SHOWING POSITION OF 3 WAY VALVES.

NOTE:- INDUCTION UNITS FROM 3RD FLOOR TO 13TH FLOOR TO HAVE SIMILAR PIPING ARRANGEMENTS BUT WITH 2 WAY VALVES.



TYPICAL DETAIL OF RUNOUT CONNECTIONS TO MAIN RISER.

(1/413) INDUCTION UNIT RISERS

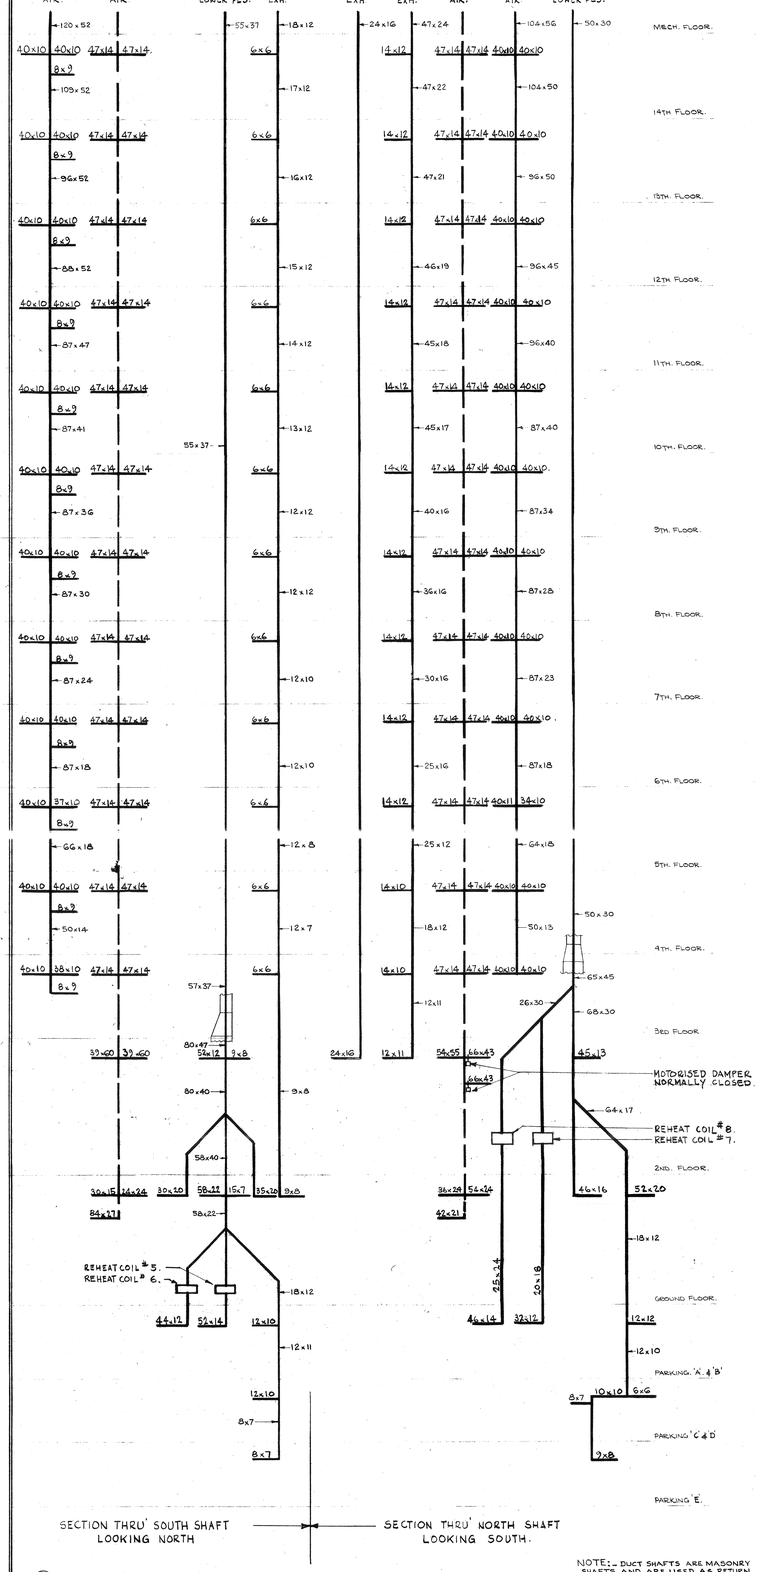

NOTE:- DUCT SHAFTS ARE MASONRY SHAFTS AND ARE USED AS RETURN AIR SHAFTS

(2/413) DUCT SHAFT RISERS

No.	Ref.	Description	Date	Ch'd

Revisions

Drawn SM
Date 5 FEB 1971
Checked A.L.
Pre-Design
Design PW
Architectural JAR
Structural BU
Heating AL
Sanitary AL
Electrical CA
Specifications KR
Process
Printed

ONTARIO ASSOCIATION OF ARCHITECTS ENGINEERS & ARCHITECTS MEMBERS

All measurements must be checked on the work by the contractor.

All prints and specifications are the property of the architects and must be returned at the completion of the work.

This drawing not to be used for construction purposes until countersigned by:

Date

NATIONAL LIFE OF CANADA

Head Office Building
University Avenue, Toronto, Canada

Parkin Searle Wilbee Rowland
Architects Engineers Planners

Sheet Title: AIR CONDITIONING RISER DIAGRAMS
Copyright ©
Scales: N.T.S.
Sheet Number: 69039-413